



# Houston Home Energy Efficiency Study

---

*December 16, 2009*

## **Advanced Energy**

909 Capability Drive, Suite 2100

Raleigh, NC 27606-3870

919 857-9000 | [advancedenergy.org](http://advancedenergy.org)



**Authors**

Shaun Hassel, Advanced Energy

Michael Blasnik, M. Blasnik & Associates (Data Analysis)

Benjamin Hannas, Advanced Energy

**Sponsoring Organizations**

U.S. Environmental Protection Agency

CenterPoint® Energy

Advanced Energy

**Contributors of Data and Reviewers**

Colby Swanson, BASF Corporation

Zak Shadid, U.S. Environmental Protection Agency

Melissa Malkin-Weber, Advanced Energy

Jennifer Carter, Masco Contractor Services, Environments for Living

Cindy Reville, Masco Contractor Services, Environments for Living

Brad Townsend, Masco Contractor Services, Environments for Living

Cheryl Bowman, CenterPoint Energy

Sam Rashkin, U.S. Environmental Protection Agency ENERGY STAR Homes Program

John Tooley, Advanced Energy

Mark Curry, Energy Sense

Brannon King, DPIS Engineering

Don Tippet, Energy Smart

Camden Watts, Advanced Energy

David Drew, Louisiana Pacific

Kelly Parker, Guaranteed Watt Savers

Frank Aranza, DOW Building Solutions

Maci McDaniels, Fox Energy Specialists

# Table of Contents

<b>Executive Summary .....</b>	<b>1</b>
<b>Introduction.....</b>	<b>6</b>
Background .....	6
Houston Building Market Overview .....	9
Study Objectives .....	11
Study Design .....	12
Study Limitations .....	12
<b>Data Collection .....</b>	<b>13</b>
Data Sets .....	13
Sources of Information .....	15
Identifying “Baseline” Homes .....	17
Self-Selection Bias, Free Riders and Spillover .....	19
Energy Usage Data: Weather Normalization .....	21
Data Merging and Sample Attrition .....	23
Adjusting for House Size .....	25
Construction Characteristics by Group .....	28
<b>Data Analysis and Discussion .....</b>	<b>29</b>
Electric Usage: Findings .....	29
Electric Usage: Construction Year Effects .....	30
Electric Usage Differences, Reference Homes and Spillover Effects .....	34
Electric Usage: Baseload .....	36
Electric Usage: Builder Effects .....	37
Electric Usage: Further Analysis - Regression Modeling .....	38
Electric Usage: Accuracy of REM/Rate Predictions .....	40
Gas Usage: Findings .....	44
Gas Usage: Further Analysis .....	46
Gas Usage: Builder Effects .....	47
<b>Conclusions .....</b>	<b>48</b>
All New Homes in Houston Are More Efficient Than in the Past .....	48
Usage Differences between ENERGY STAR and Baseline homes are small .....	49
REM/Rate Accurately Predicts Heating and Cooling Loads, on Average .....	50
<b>Recommendations .....</b>	<b>51</b>
<b>Works Cited .....</b>	<b>53</b>
<b>Website Resources .....</b>	<b>55</b>
<b>Appendix .....</b>	<b>56</b>
Regression Analysis .....	56

## List of Figures

Figure 1: Average summer/cooling energy intensity by floor and envelope area.....	26
Figure 2: Average annual electric energy intensity by floor and envelope area.....	27
Figure 3: Trends in 2008 summer/cooling loads by construction year .....	32
Figure 4: Summer/cooling loads by year of usage and year of construction.....	33
Figure 5: Baseload usage by year of usage and year of construction.....	34
Figure 6: Summer/cooling usage trends by builder and year of construction.....	38
Figure 7: REM/Rate projected cooling loads versus actual cooling loads.....	41
Figure 8: Modified box plot of REM/Rate projected cooling loads.....	42
Figure 9: Gas heating usage by builder.....	47

## List of Tables

Table 1: Home design characteristics .....	14
Table 2: Summary of data sources.....	16
Table 3: Disposition of homes in final data set.....	24
Table 4: Characteristics for RESNET reference, baseline and ENERGY STAR homes.....	28
Table 5: Electric usage analysis – sample characteristics and usage summaries .....	29
Table 6: Difference in energy use from baseline homes (adjusted for size but not vintage) .....	30
Table 7: Electric usage by year of construction (2008 kWh/yr, envelope area adjusted) .....	31
Table 8: Statistical comparison of the REM/Rate projects and billing analysis results.....	43
Table 9: Gas usage analysis – sample characteristics and basic usage summaries.....	44
Table 10: Regression modeling output for the electric summer/cooling usage .....	56

# Executive Summary

The objective of the Houston Energy Efficiency Study was to assess the actual energy use of groups of homes built to different energy efficiency specifications in Metropolitan Houston – typical non-program (baseline) homes, ENERGY STAR® homes and guaranteed performance homes. More than 226,000 homes built from 2002 through 2007 by dozens of different production builders were included in this study. The large dataset also provided the opportunity to analyze how certain construction characteristics are related to actual energy usage.

Key findings from this study include:

- ▶ All homes in Houston have become more energy efficient over time
- ▶ Usage differences between the three groups of homes were small
- ▶ Modeling predictions of the energy usage of ENERGY STAR homes are reasonably accurate
- ▶ Regression modeling provided some more detailed results on construction practices

## Background

Data collected for this project included billing data for all new homes built in the CenterPoint utility service territory from 2002 through 2007, information from property assessor databases of four counties, detailed building characteristics for tens of thousands of ENERGY STAR homes from CenterPoint's ENERGY STAR Homes tracking database, and detailed data files from energy raters including REM/Rate input files and building shell and duct leakage test data. The study did not involve any direct data collection in the field but instead relied upon existing data sources. This approach allowed the scope of the study to be much larger in terms of the number of homes analyzed but left some gaps in our understanding of some details, especially of baseline homes.

The overall dataset includes hundreds of variables for 226,873 homes, including 114,035 potential baseline homes, 106,197 ENERGY STAR homes and 6,641 guaranteed performance homes. All of the guaranteed performance homes analyzed in the Houston market were also ENERGY STAR certified. The study team applied a set of criteria to define a “Good” home for the analysis based on having sufficient data to make comparisons. Further criteria were used to define analysis groups with sufficient electric and gas usage data for analysis.

## All homes in Houston have become more energy efficient over time

Energy use for new homes in Houston dropped dramatically across all three groups built from 2002 through 2007. The total energy use decreased on average across all groups by 16 percent from

homes built in 2002 to homes built in 2007, which included a drop in both baseload usage and summer/cooling usage. These drops in usage appear to be explained by three factors:

- ▶ Establishment of a statewide residential energy code in 2001
  - > Required low solar gain windows and better insulated and tighter ducts
  - > Compliance with the new code undoubtedly improved during the first couple of years for baseline homes, which could account for a continuing decrease over a few years
- ▶ Change in federal air conditioner efficiency standards from SEER 10 to SEER 13 in 2006
- ▶ Influential “spillover” effects of high-performance home programs and initiatives adopted throughout the Houston market, including but not limited to:
  - > Programs and incentives
  - > Training and technical support
  - > Home energy rater infrastructure

These changes across all houses over time both complicate and help illuminate some of the differences between ENERGY STAR and baseline home performance. The differences also shed light on the effectiveness of changing building codes to save energy.

#### **Usage differences between the three groups of homes were small**

The data reveal all groups of homes in Houston experienced a decline in electricity consumption across construction year, and that differences in overall usage and summer/cooling usage across different groups of homes were small – only about a 5 percent difference in summer/cooling use for ENERGY STAR homes compared to baseline homes, and a 6 percent difference for guaranteed performance homes. Two primary reasons were identified that explain why the difference in usage is small:

- ▶ Typical construction practices in baseline homes were considerably better than the code-minimum HERS reference home, especially with respect to air conditioner efficiency
- ▶ ENERGY STAR home program testing of duct systems, and perhaps building envelope leakage, may have affected standard trade practices, creating “spillover” savings in the baseline homes

#### **Modeling predictions of the energy usage of ENERGY STAR homes are reasonably accurate**

Although consumption differences across groups of homes are smaller than advertised, ENERGY STAR homes perform very close to the predictions of the models on average, while baseline homes perform better than the reference homes defined by the HERS standard.

Utilizing REM/Rate cooling load projections from 10,258 homes with electric usage results, the study team found that the REM/Rate projected average cooling load of 5,506 kWh/yr was 3 percent higher than the billing analysis average cooling load of 5,677 kWh/yr. REM/Rate also estimated the average heating usage of program homes fairly well – only 4 percent lower than the measured loads.

Although the analysis found no systematic bias in the REM/Rate cooling projections, there was a large amount of variability in the data. It was found that the vintage and square footage of the home were as good of predictors of energy usage as the REM/Rate projections. However, the median absolute discrepancy between the REM/Rate cooling projection and the billing analysis result was just 17.5 percent and nearly two-thirds of the homes were within 25 percent. Overall, there is a fairly strong and consistent relationship between actual and projected performance using REM/Rate for both heating and cooling in new homes in Houston.

#### **Regression modeling provided some more detailed results on construction practices**

Regression modeling of homes with REM/Rate files was used to explore patterns in energy usage across homes and also to assess some technical performance issues. The regression analysis found:

- ▶ Savings from higher SEER air conditioners are generally consistent with simple projections based on the SEER ratings, although perhaps declining a little for SEER 15 units
- ▶ About two-thirds of the reduction in summer/cooling loads for ENERGY STAR homes from 2005 to 2007 can be accounted for by changes in SEER ratings, implying that one-third of the decline is due to other changes
- ▶ Building envelope leakage appears to be responsible for about 14 percent of summer/cooling loads while duct leakage only appears to account for about 3 percent of summer/cooling loads
- ▶ Radiant Barrier roof sheathing appears to reduce summer/cooling loads by about 3 percent of summer/cooling loads
- ▶ Cooling loads appear to increase by 0.13 kWh per annual kWh of electric baseload (waste heat from plug loads, etc.)
- ▶ Electric baseload usage is strongly related to the size of the home and also to its assessed value



## Conclusions

The combination of increased standards coupled with considerable cooperation in the marketplace toward a common goal of reducing energy use across all homes has resulted in a significant increase in the energy efficiency of new homes built in the Houston market. The relevant standards included a new statewide energy code, increased federal SEER standards and the ENERGY STAR new homes program. The cooperation included proactive programs by the electric utility (CenterPoint) to support ENERGY STAR, an active private guarantee program (Masco's Environments for Living) that requires its homes to meet ENERGY STAR standards and an aggressive and well-trained network of home energy raters. This result should provide a blueprint for future development of high performance homes programs.

This is the second study that has reached a similar conclusion. The Phoenix Home Energy Efficiency Study (Advanced Energy, 2005) followed a broadly similar approach of evaluating groups of homes built to different efficiency standards. A total of 7,141 houses with usage data were analyzed in Phoenix. One of the key findings was that many baseline homes were built essentially to ENERGY STAR specifications without receiving the ENERGY STAR label – the homes had many of the same components (e.g., windows and air conditioners). This has the effect of reducing the energy usage differences between the groups. The Phoenix market was similar to Houston in that there was significant cooperation in the marketplace among ENERGY STAR, the major electric utility, private guarantee programs and the local energy rater infrastructure.

A key component of the definition of “energy savings” is the base case that is used to calculate the savings. ENERGY STAR uses a base case reference home defined as minimum local code specifications combined with the least efficient cooling, heating and hot water systems available, a leaky building envelope and a poor duct system. Using this yardstick to measure the performance of the ENERGY STAR houses in the study, they did quite well – showing a strong and fairly consistent relationship between actual and projected performance for both heating and cooling. Therefore the apparent lack of savings is attributable not to underperformance by the ENERGY STAR homes but to the fact that the baseline houses in Houston perform considerably better than the ENERGY STAR reference house.

ENERGY STAR has played an important role in influencing standard construction practices in residential buildings. For example, the ENERGY STAR program brought duct leakage testing and building envelope leakage testing into widespread use in the new construction market in Houston. This testing is likely to have contributed toward the common use of better duct installation and building framing practices so ENERGY STAR homes would pass the test requirements. Contractors then applied these same approaches to all new homes. This phenomenon is referred to as market transformation or “spillover.”

The usage data indicated that new homes in Houston have become considerably more efficient in terms of cooling loads throughout the period 2002 through 2007, and ENERGY STAR has been crucial to this improvement. The small difference in usage between ENERGY STAR and baseline homes in Houston may not be an indicator of small program impacts but could instead be an indicator of widespread program spillover. Although we are unable to measure the exact impact of this spillover, it is clear that market transformation has taken place in Houston, positively impacting the new construction industry and delivering benefits to consumers.

# Introduction

This report documents the methodology and findings of the Houston Home Energy Efficiency Study, performed by Advanced Energy and sponsored by the U.S. Environmental Protection Agency and CenterPoint Energy. The purpose of this study is to assess and compare energy consumption patterns of homes built to three different energy-efficiency standards – baseline homes, ENERGY STAR homes and guaranteed performance homes.

## Background

The United States, with 4.6 percent of the world population, accounts for 21.7 percent of the primary energy consumption of the world. Housing alone accounts for 21 percent of the primary energy consumption of the United States and 37 percent of the electrical demands of the nation. Furthermore, electrical consumption in houses is expected to grow 39 percent between 2010 and 2020 (U.S. Department of Energy, 2004). This increased demand for electricity results in a host of different challenges: increased utility costs, electricity reliability and distribution issues, and growing environmental concerns associated with building additional electricity generation capacity.

During the past several decades, rising energy prices in particular have driven a demand for more energy-efficient homes. Builders initially responded with simple energy-saving remedies: increased insulation, double-paned glass, tighter door seals and higher efficiency HVAC equipment. Recent advancements in building science, building practices and materials technology have provided more sophisticated and effective methods of providing energy savings. These methods include improved duct sealing, infiltration barriers, low emissivity glass and compact fluorescent lighting. Each of these measures, in theory, should help reduce overall home energy usage. However, factors such as homeowners' lifestyles (with respect to energy use), effective installation of building materials and HVAC systems, increasing average home sizes and other factors make it difficult to assess the actual impact these energy conservation methods have on lowering home energy bills nationwide.

In an effort to promote energy-efficient new homes and reduce the emissions associated with home energy use, the EPA launched the ENERGY STAR qualified new homes program. The program established guidelines for building energy-efficient buildings and developed partnerships with homebuilders to construct energy-efficient homes. It was reasoned that ENERGY STAR qualified homes would offer consumers a recognizable brand that delivered dependable savings on their monthly energy bills while reducing overall energy consumption and the impact of residential sector energy use.

To qualify as an ENERGY STAR home, construction plans and building components must meet specific criteria for energy performance. Two methods can be used to assess predicted energy consumption: computer energy simulation modeling or prescriptive construction standards approved by the EPA. In Houston nearly 100 percent of the ENERGY STAR homes built are modeled with software to demonstrate they will meet the EPA ENERGY STAR guidelines.

This computer modeling produces a HERS (Home Energy Rating System) score that indicates the predicted energy performance of the home as compared to a reference home built to the local energy code. The HERS score is expressed on a scale of 0 to 100, with 100 being the assumed score of the code-built reference home. Every one-point reduction in the HERS score below 100 indicates a 1 percent decrease in predicted energy consumption. Therefore, a lower score presumes a more energy-efficient building. Since the ENERGY STAR home must be 15 percent more energy efficient than the reference home, it must achieve a HERS score of 85 or less to receive the ENERGY STAR label. The first version of the ENERGY STAR program employed a similar modeling methodology but presented the HERS score with a different scoring system. Homes built under this first version of ENERGY STAR were projected to use 30 percent less energy than the reference home. The second version of ENERGY STAR was implemented in July of 2006.

Once the building plans meet the necessary construction criteria, the presence of specific components and the effectiveness of their installation must be certified by an independent third-party professional, most commonly a HERS Rater. The typical ENERGY STAR home must pass a minimum of two field tests – duct and house envelope leakage testing – to ensure that actual construction performance matches the computer modeling in terms of house envelope leakage and duct leakage. To date there are approximately one million ENERGY STAR labeled homes nationwide.

More recently, several organizations – Masco Corporation with their Environments for Living program (Masco Corporation, 2008), General Electric with their homes inspired by ecomagination program (General Electric, 2009), Tucson Electric Power with their Guarantee Home program (Tucson Electric Power, 2008) and Advanced Energy with their SystemVision program (Advanced Energy, 2009) – have been promoting the construction of guaranteed performance homes. These homes are designed to go a step beyond the ENERGY STAR program, using advanced building science materials and techniques to lower home energy use even further. For guaranteed performance homes, the standards and testing protocol are even more stringent than ENERGY STAR in order to ensure increased energy performance.

To offset the slightly higher cost of these guaranteed performance homes and enhance their marketability, the builders or program administrators *guarantee* the annual energy usage for heating and cooling the home will not exceed a certain average level or the excess costs will be refunded to the homeowners. The programs also include a comfort guarantee that compliments the heating and cooling usage guarantee. To date, more than 130,000 houses have been built and certified to the guaranteed performance standards nationwide (Masco, SystemVision and Tucson Electric Power).

Historically, billing data for these homes (baseline, ENERGY STAR, guaranteed performance) have not been collected and analyzed to determine how the homes have performed while occupied under real-world conditions. A handful of studies have analyzed actual energy bills in an effort to evaluate the performance of various new home energy standards. In 2000, an Arizona State University (ASU) thesis study (Bashford, May 2000) conducted in Phoenix, Ariz., examined the energy consumption of 291 homes, comparing ENERGY STAR homes to non-ENERGY STAR (baseline) homes, both with and without pools. The report concluded that ENERGY STAR homes in the study used only 2.3 percent less energy per square foot than the baseline homes, a much smaller savings than anticipated. However, the sample size of the ASU study was too small to be indicative of the market at large. It also was not a random distribution of all ENERGY STAR or baseline homes.

The first statistically significant research effort evaluating end-use data in ENERGY STAR homes was completed in 2002 by the Energy Center of Wisconsin (Pigg, 2002). Utilizing billing histories and homeowner surveys, the report compared energy use between a group of approximately 100 Wisconsin ENERGY STAR homes built in 1999 and 2000 to a similar group of 170 randomly recruited non-program homes built during the same time period. The results indicated that on average, Wisconsin ENERGY STAR homes program participants used 9 ( $\pm 6$ ) percent less natural gas compared to a typical new Wisconsin home. While statistically significant, the savings were lower than prior expectations.

The primary reason for the smaller savings was the presence of high-efficient furnaces in the non-program homes. The models used to predict energy consumption differences between ENERGY STAR and non-program homes assumed that any non-program home would be built with a low-efficiency furnace. However, survey data and furnace distributor tracking data indicate that high-efficiency furnaces are installed in 83 percent of all non-program homes in Wisconsin, resulting in less natural gas usage in non-program homes than predicted by the models. This study was the first to show that the assumptions about the components and construction practices used when

building non-program homes, often referred to as baseline homes, can be inaccurate when compared to what is actually being constructed in any given market.

In 2003, the EPA determined it was necessary to complete their own study comparing the energy use of ENERGY STAR homes to non-participating homes. The Phoenix, Arizona, market was selected because it had an extensive stock of new homes, cooperative builders and home energy raters, as well as supportive local utility companies. In addition to being an early adopter of the ENERGY STAR program, Phoenix also provided a large number of guaranteed performance homes, thus allowing for an additional discrete group of homes to analyze and compare to baseline and ENERGY STAR homes.

The Phoenix Home Energy Efficiency Study (Advanced Energy, 2005) included a much larger and more diverse sample size than previous studies. A total of 7,141 houses, including 3,336 baseline homes, 2,979 ENERGY STAR homes and 826 guaranteed performance homes were analyzed. In addition to energy use profiles, information on square footage, number of stories, vintage, orientation, existence of a pool and other general characteristics were collected.

The effects of variables were limited by creating similar subsets of homes. The most comparable subset suggested that the ENERGY STAR homes on average used 3.50 kWh/ft<sup>2</sup>, compared to 4.16 kWh/ft<sup>2</sup> for typical baseline homes. This represents a savings of 16 percent for summer/cooling intensity. The same subset of guaranteed performance homes consumed 2.80 kWh/ft<sup>2</sup> on average, which is 33 percent lower summer/cooling intensity than the typical baseline homes and 20 percent below ENERGY STAR homes.

While the results of the study were statistically valid and showed a clear difference in usage across all three categories of homes, the definition of the groups of homes was intentionally biased. A number of homes that were not participating in any program but were shown to essentially meet the ENERGY STAR standard were treated as a separate baseline group. This was done because none of the groups of homes were randomly selected. So while the Phoenix Study showed that energy savings were being achieved across distinct programs with different standards, there is still a need to conduct studies utilizing real-world data that meet the following criteria: develop a data set representative of all of the homes built to different standards in a given market and randomly select an unbiased and statistically significant number of homes from each group.

### **Houston Building Market Overview**

Metropolitan Houston has become one of the largest markets in the country for new housing construction, with more than 350,000 new home starts since 2000. This level of activity is

comparable to the largest single-family construction markets in the nation. Construction by production builders makes up about 50 percent of the new construction market in Houston, with many national residential homebuilders working in the area. And Houston, like Phoenix, also has a well established network of home energy raters, as well as a large proportion of high-performance homes, including ENERGY STAR.

The Houston market was an early adopter of the ENERGY STAR label and currently has one of the highest market shares in the nation with more than 50 percent of new homes in 2008 certified as ENERGY STAR. Three important factors have driven builder support for ENERGY STAR in Houston: a supportive local utility company, an established network of HERS raters and the establishment of state energy codes in Texas for residential building in June of 2001. The utility has supported the ENERGY STAR label since 2001 through substantial marketing efforts and by partially subsidizing the cost to builders for participating in ENERGY STAR, furthering the acceptance of energy-efficient homes.

Another factor that may have contributed to the high market share of ENERGY STAR homes in Houston was the establishment of statewide energy codes for residential buildings that paralleled the development of the CenterPoint ENERGY STAR for New Homes program. Until 2001, Texas had no energy code for new residential buildings. However, in June 2001 the Texas legislature successfully passed Senate Bill 5 (SB 5), which established energy codes for residential and commercial buildings statewide. Also known as the Texas Emissions Reduction Act, this rule was passed to create fundamental improvements in energy use in an effort to help the state comply with Clean Air Act standards.

For the residential sector, this new energy code meant home builders were required to adopt the energy-efficiency requirements set forth in the 2000/2001 International Energy Conservation Code (IECC) and the International Residential Code (IRC) Chapter 11. In response to this, the Texas Energy Partnership was established. The partnership is a concerted effort by state and federal organizations, local jurisdictions and others to help cities and counties adapt to energy codes. These cities and counties in turn helped builders and developers meet the new residential energy code by allocating resources effectively and developing new building plans.

Utilities and home performance companies also helped builders meet the code with a variety of services, such as the ENERGY STAR qualified homes program. ENERGY STAR provided a route to meet the new code while also providing motivation to go beyond the code in the form of cash incentives and market differentiation. As a result, it is possible that the establishment of new

residential energy codes persuaded a number of builders to voluntarily adopt the ENERGY STAR program.

As the market share of ENERGY STAR homes grew in Houston some builders began to look for new ways of differentiating their homes. The guaranteed performance labels from various organizations provided them with the opportunity to take a step beyond ENERGY STAR in terms of energy performance without having to sacrifice many of the benefits they received from their participation in the ENERGY STAR program – independent third-party testing and certification as well as the day-to-day support of a building performance professional. In fact, many of the HERS raters in Houston certify both the ENERGY STAR and guaranteed performance homes as part of their services to builders.

These programmatic adoptions allowed Houston to be one of the first areas in the country to realize significant market penetration of energy-efficient home construction with large populations of baseline, ENERGY STAR and guaranteed performance homes. Given that these programs have been operating in Houston for more than five years now, Houston offers an excellent opportunity to verify energy consumption data on the three home types under real-world conditions. Also, Houston would serve as the first chance to use billing analysis to assess the performance of the ENERGY STAR program in a hot-humid climate.

In terms of the strategies employed to maximize energy savings in this geographic area and climate at a reasonable cost, most builders in the area focus on energy-efficiency improvements related to the following items:

- ▶ Higher performance windows
- ▶ Higher performance HVAC equipment (SEER rating)
- ▶ Properly installed insulation
- ▶ Reduced duct leakage

### **Study Objectives**

This study was structured to compare the actual energy usage of baseline homes, ENERGY STAR qualified homes and guaranteed performance program homes. The study looks at real data and real energy performance of thousands of occupied houses, not computer models. The results of the study could then be used to answer several fundamental questions about the effectiveness of these efficiency programs:

- ▶ How much energy did the baseline, ENERGY STAR and guaranteed performance homes actually consume?



- ▶ How much energy savings are realized by ENERGY STAR and guaranteed performance homes, compared to similar baseline homes?
- ▶ Has the implementation of energy efficiency programs in new home construction resulted in a reduction of total energy consumption?

### **Study Design**

More than 226,000 homes built from 2003-2007 by dozens of different production building companies were included in this study: 114,000 baseline homes, 106,000 ENERGY STAR homes and 6,600 guaranteed performance homes. Energy use histories for the homes were provided by CenterPoint Energy over the periods of 2002 through 2008. County appraisal records were used to identify those homes with swimming pools and to collect additional information about building size and other characteristics. The local energy raters and CenterPoint Energy provided additional data about the construction details of ENERGY STAR homes.

### **Study Limitations**

The study did not involve collecting any original field data about the homes. This limitation was not significant for the ENERGY STAR and guaranteed performance homes since the utility and raters were able to provide many details for these homes. But the lack of data collection limited our understanding of the baseline homes, where we primarily had to rely on basic house information contained in property assessor databases, construction requirements of the local energy code, as well as anecdotal information from builders, raters and product manufacturers. We had no measured data on air conditioner SEER or building shell or duct leakage for any of the baseline homes.

One additional factor not addressed by this study is the impact of the energy consumption habits (lifestyle) of the home occupants on overall energy use. Lifestyle choices can result in wide variances in the total energy use of a home. To account for this variability, the authors used a statistically large sample of homes to diffuse the impact of the lifestyle variable on the results of the study. It is assumed that the range of homeowner behavior is equally represented across all three categories of homes.

# Data Collection

## Data Sets

From the many sources of information included in this study, data were compiled and analyzed based on the following three categories:

- ▶ Baseline homes

Baseline homes were not built as part of any high-performance home program, but their construction specifications could be similar to those of program homes. It is important to note that a baseline home should not be referred to as a “code” home. A true “code” home rarely gets built. Most builders may voluntarily or inadvertently choose above-code components such as air conditioners, windows or water heaters based on availability of the components. The baseline homes, instead of being viewed as a “code” home or reference home, should be viewed as any home not built to a specific energy efficiency program for purposes of the study.

- ▶ ENERGY STAR homes

ENERGY STAR homes meet or exceed the energy-efficiency standards set by the EPA ENERGY STAR program. By definition, ENERGY STAR qualified homes built from July 2006 to present are independently verified to be at least 15 percent more energy efficient than a reference home built to 2004 International Residential Code (IRC) or the applicable state energy code, whichever is more rigorous. ENERGY STAR homes built before July 2006 were projected to be 30 percent more efficient than the reference home. These savings are based on heating, cooling and hot water energy use.

- ▶ Guaranteed performance homes

Guaranteed performance homes not only qualify for ENERGY STAR status but also generally include additional energy-efficiency improvements. The energy performance of these homes is guaranteed by the builders or program managers not to exceed a certain annual space conditioning fuel usage based on energy modeling. The guaranteed performance programs guarantee the energy used to heat and cool the home will not exceed the guaranteed usage listed on the front of the homeowner’s guarantee. In order to successfully deliver these guarantees, a minimum of 15 percent of these homes undergo a detailed quality verification process including a framing inspection, air barrier inspection, insulation inspection, duct leakage testing, house envelope leakage testing and room pressure testing. Homes in this category are ENERGY STAR qualified, but for

purposes of this report they were separated into their own distinct category (no duplication across groups).

For each home used in the study, the study team attempted to obtain information on the design characteristics outlined in Table 1 below. Information was collected from dozens of research reports from the Texas ENERGY STAR lab and the NAHB, and we conducted phone interviews with manufacturers, trade members, raters, builders, etc.

**Table 1: Home design characteristics**

Parameters	Notes
Home category	Baseline, ENERGY STAR or guaranteed performance home
Builder	Name of the homebuilder
Model	Model number/floor plan of the house, as provided by the builders
Square footage	Square footage for the specific home model
Year built	Year the house was built
Pool	In-ground pool included in energy use of home
Stories	Number of floors
HVAC type	Type of HVAC system
HVAC tonnage	Capacity rating of the HVAC unit
SEER	<u>S</u> ea <u>s</u> onal <u>E</u> nergy <u>E</u> fficiency <u>R</u> atio of the HVAC system
AFUE rating	<u>A</u> nnual <u>F</u> uel <u>U</u> tization <u>E</u> fficiency of the heating system
Duct tightness	Tested at CFM25*
Window type	Type of windows used (energy-efficient, double-paned, low-E glass, clear or tinted)
Exterior wall	Exterior wall structure (2×4 or 2×6)
Building tightness	Tested at CFM50*
Number of gas appliances	Number of gas furnaces, water heaters, range/ovens or gas dryers in the home
HERS score	<u>H</u> ome <u>E</u> nergy <u>R</u> ating <u>S</u> ystem score (RESNET)
Surface area of home	Area of building envelope, expressed as total sqft of envelope
Percentage of glass	Amount of glass surfaces expressed as a percent of the total building envelope area of the home
* CFM is a measure of leakiness in a structure. Duct leakage is measured at 25 Pa of depressurization (CFM25) and the building envelope leakage is measured at 50 Pa of depressurization (CFM50). These are nationally recognized units of measurement (Proctor, et al., 1993) (Keefe, 1994).	

### **Sources of Information**

Given the vast number of new and energy efficient homes constructed in Houston during the last five years, this Houston Energy Home Energy Efficiency Study was able to include an unprecedented number of homes in its final statistical analysis. Information on specific construction details, as well as home performance testing results, was collected from a number of different sources. A summary of the sources is given in Table 2 below.

**Table 2: Summary of data sources**

Data	Source	Description
ENERGY STAR program tracking data	CenterPoint Energy	Program data on 63,042 ENERGY STAR homes built from 2002 through 2007 includes: address, HERS rating, builder, community, rater, floor area, number of stories, floor plan ID, A/C unit data (capacity, SEER, model number).
Electric usage	CenterPoint Energy	Monthly electric usage data for every meter set in the CenterPoint service territory from 2002 through 2007 with data spanning from meter set through mid-September 2008. A total of 18,786,396 meter readings for 402,984 accounts.
Gas usage	CenterPoint Energy	Monthly gas usage data for every meter set in the CenterPoint service territory from 2006 and 2007 with data spanning from meter set through April 2008. A total of 1,429,692 meter readings for 95,602 accounts.
County property assessor data	Brazoria, Fort Bend, Harris and Montgomery Counties	Assessor data for all 1.3 million residential properties collected from four counties. Harris county, covering 60 percent of ENERGY STAR homes, provided the most detailed data including: assessed value, year built, floor area by level, number of rooms by type, swimming pool, owners' names, lot size, community name and more. Fort Bend, representing 27 percent of ENERGY STAR homes, provided very little data – no floor area or year built – limiting the analysis. Overall, more than 190,000 homes built in 2002 or later were identified from the other three counties.
REM/Rate <sup>1</sup> building data	Energy raters: Energy Sense, DPIS and GWS	The three largest rating firms, representing 87 percent of all ENERGY STAR homes, provided building data files or databases with about 14,000 REM/Rate <sup>1</sup> runs on about 5,000 floor plans. In Houston, ratings are calculated for floor plans and so house envelope leakage and duct leakage values are performance thresholds, not test results. The lack of house-specific leakage data and uncertainty for some other features limited some of the analyses.
ENERGY STAR rated homes list	Raters: DPIS, Energy Sense, EIC, Fox, GWS and QIS	The six largest rating firms provided lists of all ENERGY STAR rated homes from 2002 through 2008. These lists were used to identify ENERGY STAR homes not included in the CenterPoint list.
ENERGY STAR home test data	Raters: Energy Sense and GWS	Two rating firms provided building envelope leakage and duct leakage field test data totaling more than 74,000 tests.
Guaranteed performance program data	Masco / Environments for Living	The guaranteed performance program Environments for Living provided a database of program participants with more than 8,000 homes in the Houston region from 2002 to 2007.
Weather data	National Weather Service	Daily temperature data was used to develop annual weather-normalized electric and gas usage results.
<sup>1</sup> REM/Rate is a software package used by most HERS raters to complete plan reviews for ENERGY STAR and guaranteed performance builders in order to predict the energy use of a home (Architectural Energy Corporation).		

Data collection and preparation required intensive and often tedious work to obtain, clean and combine the many different datasets. Matching homes by address from different sources was a significant challenge due to frequent spelling and formatting variations and naming variations for towns. Fuzzy string matching algorithms were employed and other information such as builder

names, floor plan identifiers and community names were included when available to enhance the matching process and confirm the accuracy of matches. Manual checks were performed for thousands of potential or unclear matches (including on-line address lookups as needed).

In addition to the data listed in Table 2, a small sample of baseline home construction data were collected from a local HERS rater in the form of REScheck files. REScheck is a web-based software tool developed by the U.S. Department of Energy (DOE) that builders in Houston can use to demonstrate compliance with the local energy code (U.S. DOE, 2009). It includes many of the construction inputs raters use to generate the HERS score for ENERGY STAR and guaranteed performance houses. Unfortunately, because such a small number of REScheck files were obtained, the exact specifications of building components for baseline homes cannot be known or predicted with any accuracy. Instead, a number of product manufacturers and distributors, installers, code officials and others familiar with the Houston residential market were interviewed in an effort to characterize the market for energy-efficient products and standard practices in Houston baseline homes.

In regards to the integrity of information for sources listed in Table 2, quality checks were performed on the data to exclude obvious errors. These algorithms are discussed in the Data Merging and Sample Attrition section below (beginning on page 23). However, the following should also be noted:

- ▶ Data provided by supporting organizations, raters and county appraisal databases were not field verified by the study team.
- ▶ The energy consumption habits of the occupants (lifestyle) were not directly evaluated in this study. The study team realizes lifestyle can be an important variable affecting the energy consumption of a home. Therefore, a large statistical sample size is used to minimize the significance of the variations across and within groups.

Once all of the database information, monthly energy use histories and building inputs were collected for ENERGY STAR, guaranteed performance and baseline homes in Houston, a data set was developed using the procedures outlined in the following sections.

### **Identifying “Baseline” Homes**

The electric and gas usage data files were generated by CenterPoint Energy based on utility customers who had a “meter set” event in the specific time frame. This criterion was employed to obtain data on baseline homes – new homes that did not participate in the ENERGY STAR or guaranteed performance program.

One complication from using meter set dates is that meters may be set in existing homes due to routine meter replacements and other circumstances. In order to be sure that the baseline homes are actually new homes, the county property assessor data files are used, which included the year built for three of the four counties analyzed (Fort Bend being the exception). About one-third of the homes listed as completed by ENERGY STAR in any given year are listed as built the prior year by the property assessor data – apparently the assessor figure may be based on issuance of permits, not completion. For consistency, the property assessors' year is used when comparing ENERGY STAR and baseline homes.

Overall, 216,860 homes are matched between the assessor data and the utility data – 102,825 ENERGY STAR homes and 114,035 other homes. For the three counties that provided data on year of construction, 87 percent of homes built from 2002 through the present are successfully matched with energy usage data. For Harris County, where CenterPoint service territory covers essentially the entire county, the matching rate is 97 percent. For Fort Bend County, where year of construction is not known, 30 percent of all homes are matched, but many of these may not be new.

The property assessor files also included the floor area of the home for all counties except Fort Bend. This information is critical for properly comparing the energy use of baseline and ENERGY STAR homes so that observed differences are not just due to differences in house size. The assessor data also allows the analysis to identify homes in both groups that should be excluded for certain analyses. The assessor information is used to:

- ▶ Identify homes that may not have been sold yet based on the owner name being a company or partnership
- ▶ Identify townhouses or other attached or multifamily units that are considered outside the focus of this analysis
- ▶ Identify baseline homes that are not comparable to any ENERGY STAR homes – specifically homes where the floor area or property assessment value are outside the range of values found among ENERGY STAR homes
- ▶ Identify homes with swimming pools so they can be excluded from most analyses since swimming pools represent a large and variable load that obscures total usage and especially cooling load estimates

Since Fort Bend County assessor files do not include the year of construction, the study team could not be sure which homes were actually built in the target timeframe. One method for trying to identify new construction is to flag homes that are located in communities that also had ENERGY STAR homes. This approach should mostly identify developments that were still actively building in the target timeframe, but still may include homes built prior to 2002. Because of this uncertainty in

the baseline homes, all homes from Fort Bend County are excluded for most analyses – including 23,195 ENERGY STAR homes, representing 23 percent of all ENERGY STAR homes built throughout the study period in metro Houston.

One additional complication in identifying appropriate baseline homes is the heating and water heating fuels are not provided in the property assessor data. The CenterPoint ENERGY STAR homes database reports just seven electrically-heated homes out of more than 63,000 homes listed. Homes with electric heat can readily be identified based on the size of the winter load from the usage analysis, but water heating is more complicated to identify.

The REM/Rate files indicated electric water heating in 427 of the 33,325 homes with REM data (1.3 percent). There is no clear method for identifying electric water heating from electric usage data. Electric water heating is reportedly quite rare in the Houston market. Still, a difference in electric water heating rates between the baseline and ENERGY STAR homes could skew results, especially when assessing baseload or total usage. For the homes listed as having electric water heating, the annual baseload electric usage averaged 1,838 kWh (21 percent) greater than those with gas water heating, while the summer/cooling load averaged just 104 kWh (1.8 percent) greater. It appears that potential differences in electric water heating penetration between baseline and ENERGY STAR homes are unlikely to have a significant impact on estimated summer/cooling loads, but could have an effect on baseload and total usage. Since the frequency of electric water heating among the baseline homes is uncertain (although it is expected to be quite low) the most reliable comparisons between groups will likely be for the summer/cooling loads.

### **Self-Selection Bias, Free Riders and Spillover**

Although substantial effort was taken to develop a well-matched group of baseline homes, self-selection bias is still an issue that needs to be considered in any comparisons between the ENERGY STAR and baseline homes. Self selection is the term used to describe the potential bias that can arise because builders choose to participate in the program (or not) and this choice may reflect differences between the participant and baseline groups that are hard to measure or adjust for.

Free riders refers to the phenomenon of ENERGY STAR builders who were already planning to build more efficient homes, making it easy for them to comply with ENERGY STAR standards and participate in the program<sup>1</sup>. For ENERGY STAR homes, there are unlikely to be many pure free riders as few builders would actually pay to have duct leakage and building envelope leakage

---

<sup>1</sup> The study of ENERGY STAR homes in Phoenix found that many of the builders who joined the program were already building many homes with similar energy features.



tested on each home. However, there may be many partial free riders as builders planned to install the same higher efficiency equipment, windows and insulation levels as called for by ENERGY STAR. From the perspective of the broader ENERGY STAR homes program, free riders may not be considered a problem but simply a well deserved reward for builders who are already building more efficient homes. But from the perspective of a local utility trying to achieve specific net load reductions, free riders reduce the net program impacts.

The opposite type of bias can also occur – spillover (a.k.a., free drivers). Spillover refers to energy impacts produced by the program in homes that do not actually participate in the program. This effect is thought to be occurring in the Houston ENERGY STAR homes program with respect to duct leakage and perhaps building envelope leakage. As noted previously, duct systems in Houston are installed by a few major contractors. The large market share of ENERGY STAR and the duct leakage testing requirements of the program have made these contractors develop consistent methods for installing tight duct systems. These same installation methods are then used on all homes, leading to tighter duct systems in non-ENERGY STAR homes. A similar effect may have occurred with framing and insulation contractors related to building envelope leakage requirements of ENERGY STAR. The net impact of spillover is that baseline homes become more efficient due to the program and therefore the difference in energy usage between baseline and ENERGY STAR homes narrows, making the program appear less effective, when in reality it is more effective.

An example of how large an impact spillover can have may be instructive. Assume that ENERGY STAR home cooling loads average 4,000 kWh and baseline homes loads would have averaged 5,000 kWh (without spillover) for a 1,000 kWh (20 percent) difference in loads. Then assume spillover causes the baseline duct system to be built tighter, resulting in a modest 5 percent reduction in their cooling loads. Now we actually observe baseline cooling loads of 4,750 kWh (5000 times 95 percent), implying program savings of just 750 kWh. But the effect on net program impacts is even larger because the program has produced savings in the non-program homes. If ENERGY STAR has a 50 percent market share, then the true net savings of the ENERGY STAR program is 1,250 kWh per participant (1,000 kWh of participant load reduction plus 250 kWh of non-participant load reduction), yet we only observe 750 kWh savings. This example illustrates how a modest spillover effect can create a large downward bias in apparent program impacts. If the total spillover in this example led to a 7 percent change in the baseline home loads, then observed program impacts would have been just half the actual impacts.

There are also other types of spillover effects that may occur, such as some builders building ENERGY STAR compliant homes but not bothering to participate in the formal program. The

Phoenix Home Energy Study showed some home builders constructing homes to the ENERGY STAR standards, but not paying for the ENERGY STAR label for the home.

### **Energy Usage Data: Weather Normalization**

The raw monthly energy usage data for each customer was first analyzed using weather-normalization procedures to adjust for variations in weather between the period covered by the meter readings and average weather patterns. The results from the weather normalization include estimates of the annual total energy usage as well as a break out of this usage into weather sensitive and baseload components. Weather normalization is not perfect, but provides a much better basis for comparing energy usage between homes and over time than simply summing or averaging the raw monthly energy bills.

The gas usage data are analyzed using a variable-base heating degree day regression analysis similar to the widely-used PRISM software (Fels, 1986). The usage data were first screened to flag potential periods of vacancy as indicated by unreasonably low usage and off-cycle meter readings. Given the relatively limited timeframe covered, all usage data were pooled together for each customer. Weather normalization results were classified as unreliable if:

- ▶ The usage data included fewer than nine meter readings or 240 days or included less than half the heating degree days of a typical winter or the heating degree days per day ranged by less than the annual average HDD/day
- ▶ The model fit from the regression was poor:  $R^2 < 0.6$  or the estimated standard error of the annualized usage was greater than 20 percent
- ▶ The heating load was less than 50 therms or the baseload was less than 40 therms, indicating likely vacancy
- ▶ After passing all prior screens, homes with extreme usage were identified as those where the total usage per square foot of floor area was in the highest or lowest two percent of homes in each housing group – these homes most likely represent either homes that were not fully occupied in the period or homes with very unusual occupancy patterns

For electric usage data, weather normalization was performed using a heating and cooling degree day adjustment procedure (HDD is heating degree day and CDD is cooling degree day). This approach classified each meter reading period into one of three seasons – summer, winter or baseload – based on heating and cooling degree days. The usage and degree days were then summed for each season and the resulting data was used to create three equations that can be solved to estimate baseload usage per day, summer/cooling usage per CDD and winter/heating usage per HDD, assuming linear relationships. This method allows for heating or cooling to occur in any season and tends to provide fairly robust (i.e., reliable) results that can work better than regression models when usage patterns are unusual or seasonal loads are small.

For this analysis, the CDD was calculated with a balance point temperature of 69°F and HDD with a balance point temperature of 62°F. The cooling balance point was selected by fitting a variable-base cooling degree day regression model for all homes classified as having no apparent winter seasonal load and then using the median of the estimated balance point temperatures. A similar analysis approach was taken for the study of ENERGY STAR homes in Phoenix (Advanced Energy, 2005) and the median balance point temperature there was found to be considerably higher at 74°F. The difference in estimated balance point temperatures is most likely related to a large difference in summer humidity levels.

Electric usage data were first screened to remove periods of likely vacancy and other anomalous or questionable data and then cases with insufficient data, defined as fewer than 11 usable meter readings in the year, were removed prior to the weather normalization. The weather normalization results were then screened to identify unreliable cases, defined as:

- ▶ Total raw electric usage of less than 3,000 kWh for the year, or no summer/cooling load or annual baseload less than 2,400 kWh
- ▶ Annualized winter/heating load estimated at 0.75 kWh per square foot of floor area or more – to remove potential electric heating customers, which were uncommon in ENERGY STAR homes
- ▶ After passing the prior screens, homes with extreme usage were identified as those where the annual summer/cooling load per square foot of floor area was in the highest or lowest two percent of homes in each housing group – these homes most likely represent homes that were not fully occupied in the period or homes with unusual occupancy patterns

The electric usage analysis was run separately for each home during each calendar year except that the final year was defined as September 2007 through September 2008. Given the growing number of homes built and occupied each year, the 2008 results were the primary results analyzed.

The outputs from the electric usage analysis are referred to as the summer/cooling load, the winter/heating load and the baseload. These terms are used to reinforce the fact that many electric loads are seasonal and will appear as part of the winter or summer seasonal usage component, even though they are not space conditioning. Summer-peaking end uses include pool pumps, fans, dehumidifiers and refrigerators, while winter-peaking end uses include the furnace fan and lighting. For a climate like Houston, the vast majority of the estimated summer/cooling load will tend to be actual air conditioning usage if no pool is present, while the entire winter/heating load will tend to be seasonal end uses.

### **Data Merging and Sample Attrition**

The biggest task for the project was to create a single dataset with information on all homes derived from all available data sources (see Table 2 for a list of these sources).

The detailed building data from the REM/Rate files required significant processing. First, 14,017 individual REM \*.blg files provided by raters needed to be processed through REM/Rate to create a relational database of building data. Next, 45 different data tables of outputs in the REM export database were processed to summarize key building characteristics into a single data record for each home or floor plan that included more than 150 pieces of information. Data elements extracted included the areas and rated performance values (e.g., R-values, U-values, SHGC, SEER, AFUE, EF) of all major building components and systems as well as load projections from the REM software.

The weather-normalized electric usage dataset was matched with the ENERGY STAR homes database to create a master file of all homes of interest. Each other data set was then matched and merged into this master file, including the gas usage analysis results, the energy rater field test data and additional rated homes lists, the county property assessor data and finally the REM data.

The combined master dataset includes more than 500 data fields for each home and contains information on 226,873 homes including 114,035 potential baseline homes, 106,197 ENERGY STAR homes and 6,641 guaranteed performance homes. The CenterPoint ENERGY STAR tracking system included data on 63,042 homes, while an additional 49,796 ENERGY STAR homes were identified from energy rater lists. The homes in the combined dataset include many homes where some key information is not available or where the home may not be appropriate for the analysis for other reasons. A set of screening criteria is applied to define a “Good” home for analysis and then the usage analysis screens are applied to define “Good” homes for the electric usage analysis and for the gas usage analysis. The following table summarizes the disposition of homes in the dataset.

**Table 3: Disposition of homes in final data set**

	Baseline	ENERGY STAR	Guaranteed Performance	Total
All homes	114,035	106,197	6,641	226,873
Unknown year built (Ft. Bend, no ES)	17,837	0	0	17,837
Assessed value outlier	29	0	0	29
Floor area outlier	19	0	0	19
Not sold	7,597	6,190	300	14,087
Townhome	1,169	1,009	37	2,215
Floor area unknown (Ft. Bend)	9,547	12,278	2	21,827
Homes remaining	77,837	86,720	6,302	170,859
Floor area: not 1200 ft² - 5000 ft²	4,276	2,332	54	6,662
Swimming pool	2,733	2,633	133	5,499
"Good" homes	70,828	81,755	6,115	158,698
<b>Electric usage attrition</b>				
No usage results (2008)	19,048	21,540	1,421	42,009
No cooling load	307	233	13	553
Winter / Heating Load > 0.75 kWh/ft²	6,504	4,475	314	11,293
Baseload < 2,400 kWh/yr	2,282	2,603	217	5,102
Outlier Cool kWh/ft² in 2% tails	1,706	2,136	146	3,988
"Good" Homes with Electric	40,981	50,768	4,004	95,753
Fort Bend / other county	0	8,614	1,209	9,823
"Good" homes, electric – comparable	40,981	42,154	2,795	85,930
<b>Gas usage attrition</b>				
No usage results	51,881	52,485	4,637	109,003
Usage data insufficient / unreliable	7,138	9,979	499	17,616
Usage low (base<40 or heat<50)	544	417	29	990
Outlier total therms/ft² in 2% tails	450	746	46	1,242
"Good" homes with gas	10,815	18,128	904	29,847
Fort Bend / other county	0	2,827	245	3,072
"Good" homes, gas – comparable	10,815	15,301	659	26,775

The top portion of table shows the causes for excluding homes from the analysis and the lower portions show usage analysis attrition. The largest sources of attrition were related to Fort Bend county not providing data on year of construction or floor area. Attrition causes, in order of screening, included:

- ▶ “Unknown year built” includes homes where the year of construction is unknown from either county or ENERGY STAR program records and there are no ENERGY STAR homes built in the same community during the target timeframe – the study team has no knowledge of how recent these homes were built and so cannot use the data in the analysis
- ▶ “Assessed value” and “Floor area” outliers include baseline homes where the assessed value is greater than the assessed value of any ENERGY STAR home or the floor area is smaller than or larger than any ENERGY STAR home
- ▶ “Not sold” refers to homes where the most recent owner of record is a company of some type, implying the home may not have been sold by the builder – baseline homes are more likely to be unsold than ENERGY STAR homes, 7.9 percent vs. 5.8 percent
- ▶ Townhomes are excluded from the analysis because of their relatively small number and the difficulty in properly accounting for house size in comparisons
- ▶ “Floor area unknown” is self-explanatory and mostly includes homes in Fort Bend County – either baseline homes or ENERGY STAR homes not listed in the CenterPoint tracking system – this category also includes some cases with errors in the data (e.g., a 90 ft<sup>2</sup> home)
- ▶ A subtotal of “Good” homes is provided next to show how many homes appear to be viable for the analysis, however, two further screens are used for most comparisons
- ▶ “Floor area not 1200 ft<sup>2</sup> - 5000 ft<sup>2</sup>” eliminated homes that are very small or very large compared to the vast majority of ENERGY STAR homes
- ▶ “Swimming pool” homes have pools and are removed from most analyses due to their large impact on consumption, which also confounds cooling load estimates

A total of 158,698 homes passed all of the house screening criteria. The remaining sections of the table show the sample attrition from the various usage analysis screens applied to these “Good” homes. Many of the homes with “No Usage” were built in 2007 and not enough time had elapsed since occupancy to assess annual usage.


One further screen applied to the electric and gas analysis groups is to identify all remaining homes from Fort Bend County or from counties other than Harris, Montgomery and Brazoria, where we have no baseline homes. These homes could be included in any direct comparisons between ENERGY STAR and guaranteed performance homes but should be excluded from comparisons to baseline homes to avoid potential bias from differing construction practices or demographics between counties.

### **Adjusting for House Size**

House size is typically accounted for when comparing energy usage between homes. The most common metric has been energy usage per square foot of floor area, which has intuitive appeal and is based on readily available data. A problem with this approach is that building heat gain and loss should scale more directly with the area of the building envelope, which grows at a different

rate than floor area. An effective size adjustment approach should show no relationship between usage intensity and house size for homes of similar efficiency. This assumption was examined by looking at data from 11,828 ENERGY STAR homes built in 2005. The following figures show the average usage intensity calculated by floor area and by envelope area for the summer/cooling loads and the total electric loads.


**Figure 1: Average summer/cooling energy intensity by floor and envelope area**

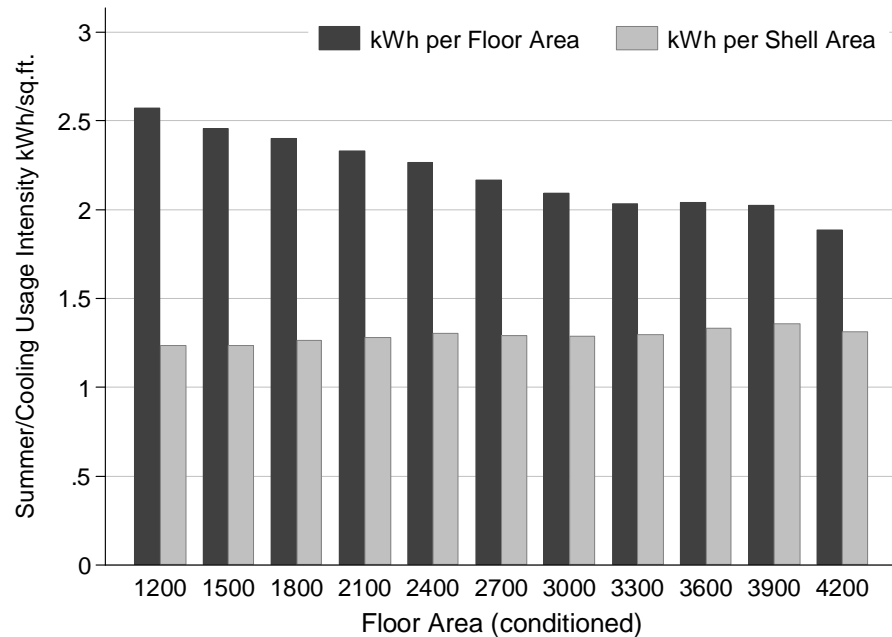

The summer/cooling usage per floor area drops as the size of the home grows while the usage per envelope area increases slightly. Over the common size range of 1500 – 3000 ft<sup>2</sup>, the usage per floor area drops 15 percent while the usage per envelope area increases just four percent.

The advantage of normalizing for envelope area is even greater for comparing total usage, as can be seen in Figure 2. The total kWh per floor area drops by 18 percent from 1500 to 3000 square feet while the kWh per envelope area increases by just 1 percent.

**Figure 2: Average annual electric energy intensity by floor and envelope area**

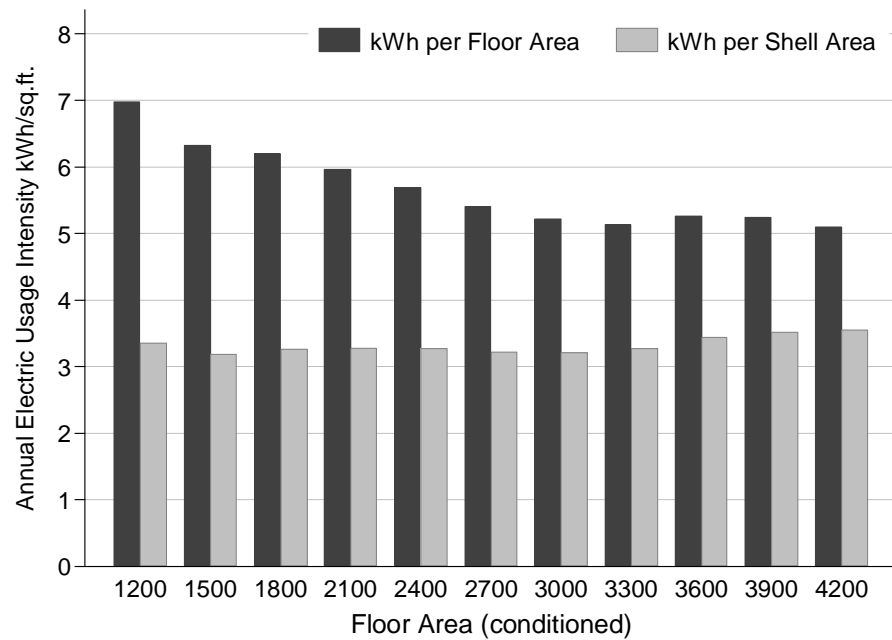

Based on these patterns, building envelope area was used as the primary method for adjusting for house size. Because building envelope areas are not well known or intuitive, rather than provide results in “kWh/ft<sup>2</sup> envelope”, the usage per envelope area was multiplied by the average envelope area of 4,329 ft<sup>2</sup>, calculated from the 87,870 ENERGY STAR and guaranteed performance “Good Homes”. The result of this calculation is an annual usage value based on adjusting the house size to the average ENERGY STAR home size.

The property assessor and ENERGY STAR homes databases did not have envelope areas, but this information was available for homes with REM data. The study team developed an equation to estimate the above-grade envelope area based on floor area and number of stories and applied the equation to all homes:

$$\text{Above grade envelope area} = \text{Footprint} + 39.6 * \text{Stories} * \sqrt{\text{Footprint}}$$

$$\text{where Footprint} = \begin{cases} \text{floor area, if 1 story} \\ \frac{\text{floor area}}{1.8}, \text{ if 2 story} \end{cases}$$

The estimates from this equation have a correlation of 0.9 with the REM-derived above-grade area and are within 20 percent of the REM number for 94 percent of all homes.



### Construction Characteristics by Group

Table 4 summarizes the construction characteristics of the RESNET reference home, estimated baseline home and ENERGY STAR home. The RESNET reference home is used in REM/Rate to calculate the HERS score and ENERGY STAR eligibility of a home, but available data indicates that the standard baseline home built in the Houston market differs in some key ways from the assumed reference home. As of the 2006 code change, a baseline home is nearly identical to an ENERGY STAR home for each of the specs given in Table 4, whereas the RESNET reference home differs in many ways. The largest discrepancy between the reference home and the typical baseline home is air conditioner SEER. Much of the projected savings from ENERGY STAR are due to the assumption that the reference home installs the least efficient equipment available. In Houston, the code changes led to very little difference between ENERGY STAR and baseline construction practices, making the projected difference in SEER even more critical for achieving savings.

**Table 4: Characteristics for RESNET reference, baseline and ENERGY STAR homes**

Values are for 2002 to 2008 2006 code changes indicated with brackets, DHW changed in 2004			
	(projected)	(actual)	
	RESNET Reference	Estimated Baseline	ENERGY STAR
Wall R-value	13	14	14
Roof/ceiling R-value	30	30	30
Normalized leakage, nL	0.57 <b>(0.48)</b>	?	0.40 <b>(0.39)</b>
Glazing U-factor, effective	0.75	0.54	0.54 <b>(0.52)</b>
SHGC	0.40	0.36	0.36
Percentage window area	18%	14%	14%
R-value return ducts	4	6	6
R-value supply ducts	8	6	6
Default distribution efficiency	0.80	?	~0.88
Furnace AFUE	78%	80%	80%
Air Conditioner SEER	10 <b>(13)</b>	11.5+ <b>(13.5)</b>	12.6 <b>(13.7)</b>
DHW, gas efficiency	0.54 <b>(0.59)</b>	0.54 <b>(0.59)</b>	0.59 <b>(0.60)</b>
DHW, electric efficiency	0.86 <b>(0.91)</b>	0.86 <b>(0.91)</b>	0.91
<sup>1</sup> 1999 NAHB baseline data, pre-code, standard construction spec estimates, Harris County			
<sup>2</sup> 2000/2001 IECC, post-code home, standard construction spec estimates			

# Data Analysis and Discussion

## Electric Usage: Findings

Table 5 summarizes the characteristics of the homes in the electric usage analysis and provides some initial basic usage summaries. The table is restricted to homes built in Harris, Brazoria and Montgomery counties.

**Table 5: Electric usage analysis – sample characteristics and usage summaries**

	Category			Difference vs. Base	
	Base	ES	GP	ES	GP
Number of homes	40,981	42,154	2,795		
Floor area	2,356	2,466	2,454	110 ±10	98 ±28
Envelope area (above grade)	4,145	4,285	4,279	140 ±12	133 ±34
One-story home	42%	43%	45%	1%	3%
Brazoria County	6%	10%	16%	5%	11%
Harris County	89%	83%	78%	-6%	-11%
Montgomery County	6%	5%	4%	-1%	-2%
Assessed value (median)	\$150,876	\$162,433	\$165,000	\$11,557	\$14,124
% Homes by year built					
Built 2002	24%	8%	17%	-16%	-7%
Built 2003	19%	18%	31%	0%	12%
Built 2004	17%	20%	19%	3%	2%
Built 2005	18%	25%	14%	7%	-4%
Built 2006	18%	23%	14%	5%	-4%
Built 2007	4%	5%	5%	1%	1%
2008 Electric usage: unadjusted					
Summer/cooling	5,543	5,438	5,339	-105 ±27	-205 ±77
Baseload	8,511	8,533	8,849	22 ±60	338 ±175
Total kWh/yr	14,054	13,971	14,187	-83 ±77	134 ±222
2008 Electric usage: size adjusted					
Summer/cooling	5,770	5,471	5,394	-298 ±21	-375 ±60
Baseload	8,871	8,618	8,950	-253 ±53	79 ±157
Total kWh	14,641	14,089	14,344	-552 ±62	-297 ±183
Note: ± values are 95% confidence intervals on the difference in means between the ENERGY STAR (ES) or guaranteed performance (GP) homes and the baseline (Base) homes.					

All three groups of homes have a similar average size and number of stories, although baseline (Base) homes are about 1 percent smaller yet slightly more like to have two stories. Baseline homes are less likely to be located in Brazoria County, and their median assessed value is about 7

percent lower than ENERGY STAR (ES) and 9 percent lower than guaranteed performance (GP) homes.

There are some differences in the vintages of the three groups of homes. A much larger fraction of baseline homes than program homes were built in 2002 when the ENERGY STAR and guaranteed performance programs were ramping up. Almost a third of guaranteed performance homes were built in 2003 compared to less than a fifth of the other homes. ENERGY STAR homes were generally built more recently with most built from 2005 through 2007.

The differences in year of construction make the summary usage comparisons at the bottom of the table potentially biased to the extent that codes, standards or common construction practices changed over time. Still, the table shows the program homes have slightly lower summer/cooling loads than the baseline homes, but slightly larger baseload usage. The bottom three rows adjust for house size (via envelope area) and show ENERGY STAR homes had about 5 percent lower summer/cooling loads and 4 percent lower total electric use than baseline homes, while guaranteed performance homes had about 6 percent lower summer/cooling loads but just 2 percent lower total use compared to baseline homes. However, these comparisons are not very useful due to unaccounted for differences between the groups, especially concerning house vintage.

**Table 6: Difference in energy use from baseline homes (adjusted for size but not vintage)**

	Percent Usage Difference vs. Baseline	
	ENERGY STAR	Guaranteed Performance
Summer/cooling kWh (2008)	5% less	6% less
Total kWh (2008)	4% less	2% less

#### **Electric Usage: Construction Year Effects**

The table below summarizes the electric usage for each group of homes by year of construction.

**Table 7: Electric usage by year of construction (2008 kWh/yr, envelope area adjusted)**


	Category			Difference vs. Base	
	Base	ES	GP	ES	GP
<b>2008 Summer/cooling</b>					
Built 2002	6,194	5,977	5,660	-217 ±62	-535 ±148
Built 2003	5,885	5,822	5,500	-63 ±48	-385 ±109
Built 2004	5,856	5,674	5,527	-183 ±47	-329 ±133
Built 2005	5,673	5,500	5,387	-173 ±44	-286 ±155
Built 2006	5,248	4,974	4,855	-273 ±42	-393 ±144
Built 2007	5,068	4,739	4,861	-329 ±83	-208 ±239
<b>2008 Baseload</b>					
Built 2002	9,282	9,033	10,537	-249 ±161	1255 ±390
Built 2003	9,224	8,812	9,106	-413 ±127	-119 ±295
Built 2004	8,800	8,570	8,241	-229 ±121	-559 ±351
Built 2005	8,762	8,619	8,489	-143 ±117	-273 ±426
Built 2006	8,408	8,458	8,165	49 ±114	-244 ±385
Built 2007	7,587	8,176	8,835	589 ±230	1248 ±601
<b>2008 Total electric usage</b>					
Built 2002	15,476	15,010	16,197	-467 ±187	721 ±449
Built 2003	15,109	14,633	14,606	-476 ±147	-503 ±337
Built 2004	14,656	14,244	13,768	-412 ±142	-888 ±407
Built 2005	14,435	14,118	13,876	-317 ±136	-559 ±494
Built 2006	13,656	13,432	13,019	-224 ±131	-637 ±443
Built 2007	12,655	12,915	13,696	260 ±264	1041 ±705
<i>Note: Italics indicate small sample size for the guaranteed performance 2007 group of just 131 homes.</i>					

The sample sizes for the guaranteed performance homes are fairly modest compared to the other groups – with about 400 to 500 homes each year except for 852 homes in 2003 and just 131 homes in 2007. The baseline and ENERGY STAR groups mostly have at least 7,000 to 10,000 homes in each year with the exceptions of 3400 ENERGY STAR homes in 2002 and 1,600 baseline and 2,200 ENERGY STAR homes in 2007.

Table 7 shows the electric usage of new homes dropped dramatically for all three groups from homes built in 2002 to homes built in 2007. The summer/cooling load of baseline homes declined by 18 percent over the period – from 6,194 kWh for homes built in 2002 to 5,068 kWh for homes built in 2007. During the same period, ENERGY STAR homes dropped by 21 percent and guaranteed performance homes dropped by 14 percent.

The trends in summer/cooling loads over time by group are illustrated in Figure 3. The decline in loads over time is clear.

Figure 3: Trends in 2008 summer/cooling loads by construction year

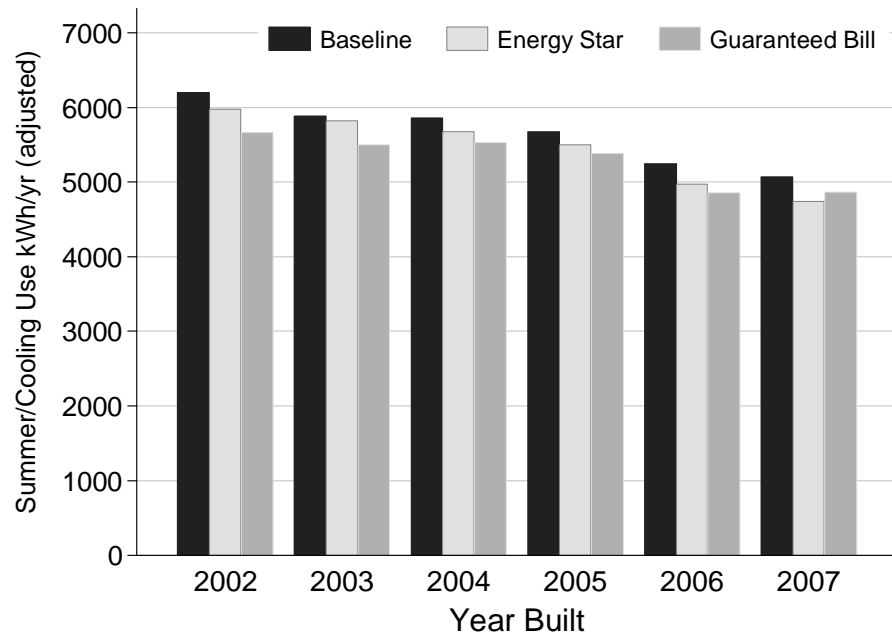

There are two primary reasons why declining summer/cooling loads are expected in all homes:


- ▶ The local building code changed in late 2002 to require low solar gain windows and better insulated and tighter ducts, and compliance with the new code undoubtedly improved over the first couple of years for baseline homes
- ▶ Federal air conditioner efficiency standards changed from SEER 10 to SEER 13 in 2006

These changing loads over time both complicate and help illuminate some of the differences between ENERGY STAR and baseline home performance. The differences also shed light on the effectiveness of changing building codes to save energy.

An alternative explanation for the observed differences in electric usage by house vintage may be that electric usage changes over time for a given home and so the differences in the 2008 usage between homes built in 2003 and homes built in 2007 may have something to do with the fact that the 2003 home has been lived in longer. This possibility was explored by examining the electric usage changes over time for each year of construction.

Figure 4 shows the summer/cooling load for each year since construction for homes of each vintage.


Figure 4: Summer/cooling loads by year of usage and year of construction

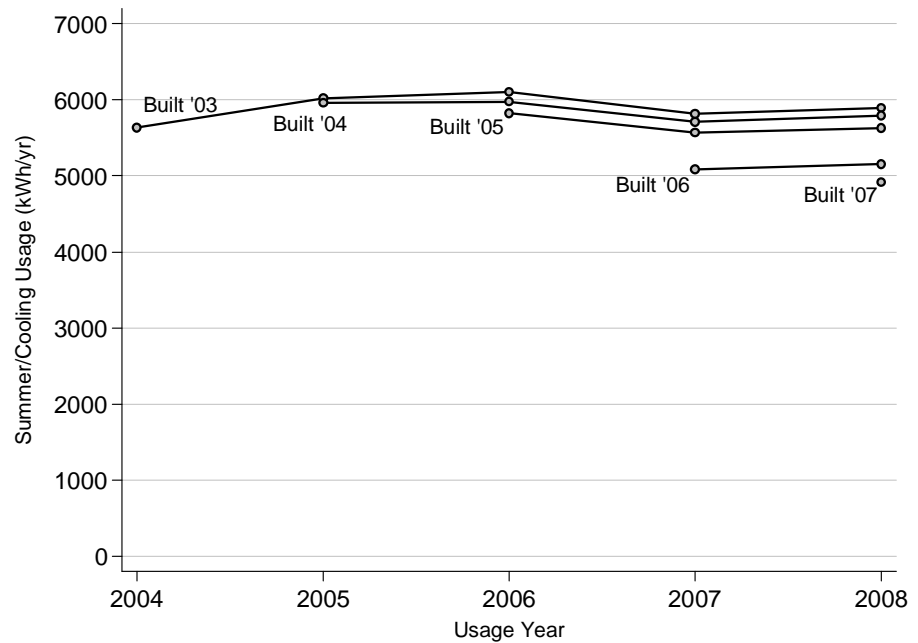

The figure shows summer/cooling usage has remained relatively constant from year to year, with the largest exception being homes built in 2003 showing a noticeable increase in summer/cooling loads in 2005 compared to 2004. In subsequent years, the only pattern for any vintage appears to be more related to the calendar year than to the length of occupancy, implying variations due to temporal effects such as weather impacts not captured by cooling degree days or electricity price.

Figure 5 assesses trends in baseload electric usage. It appears there is some growth in baseload over time, especially for the 2005 and 2006 vintages. The trends imply that using the 2008 baseload usage may give a biased assessment of the 2007 vintage homes' baseload.

**Figure 5: Baseload usage by year of usage and year of construction**

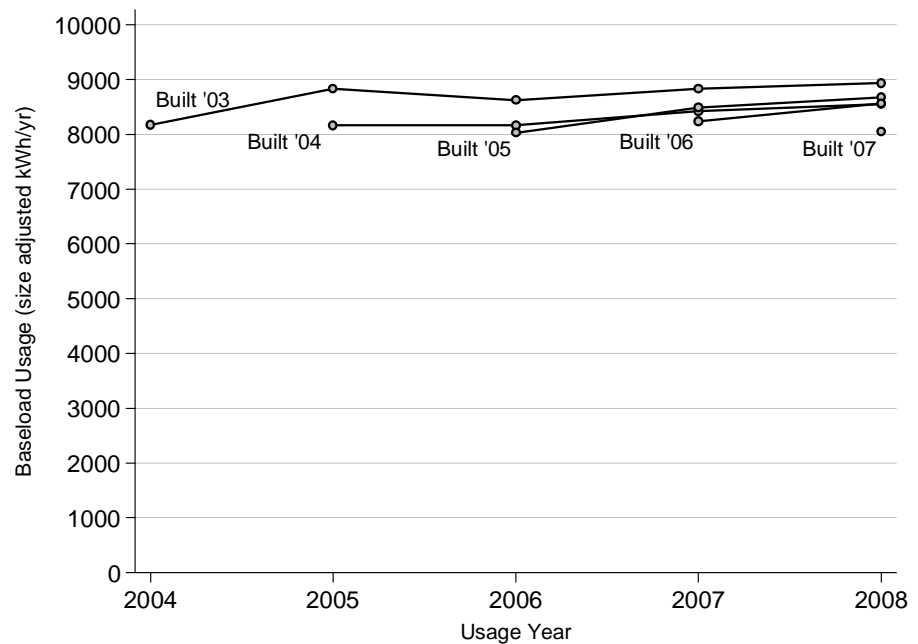

### Electric Usage Differences, Reference Homes and Spillover Effects

ENERGY STAR homes were advertised as using 30 percent less energy than code-built homes prior to 2006 and 15 percent less energy than code-built homes since then. The usage data indicate that the ENERGY STAR homes used about 4 percent less summer/cooling energy than the baseline homes and the guaranteed performance homes only used a little less than that. After examining the available data, there are two primary reasons why the difference in usage is so small:

- ▶ Typical construction practices were considerably better than the code-minimum HERS reference home, especially with respect to air conditioner efficiency
- ▶ ENERGY STAR home program testing of duct systems, and perhaps building envelope leakage, may have affected standard trade practices creating spillover savings in the baseline homes

The local building code allowed builders to make a trade-off between air conditioner efficiency and duct insulation levels. Builders could use R-6 ducts rather than R-8 (which are more expensive, difficult to work with and reduce available floor space) if they installed a SEER 12 air conditioner prior to the 2006 change or a SEER 14 unit after the change. Data from market research studies and interviews with local stakeholders indicate that many builders were installing higher-than-

minimum efficiency air conditioners even before the code change. This belief is reinforced by the billing data results.

The summer/cooling loads of baseline homes dropped by 11 percent after the Federal standard changed in 2006 from SEER 10 to SEER 13 (comparing 2005 to 2007 usage). This reduction is only half as large as one would expect if the average air conditioner SEER had actually increased from 10 to 13. If the average SEER had instead changed from 12 to 14 then cooling loads should have dropped by about 14 percent, which is more consistent with the measured data. If the typical baseline home had a SEER 12 air conditioner rather than the SEER 10 specified by the HERS reference home, then the actual cooling savings from a SEER 13 unit would only be about 8 percent rather than the 23 percent expected for SEER 10. This difference in baseline practice would have a dramatic impact on the cooling load savings from ENERGY STAR prior to 2006. Similarly, the SEER 13 reference home assumption starting in 2006 may be responsible for a 5 to 8 percent discrepancy for homes built since then if SEER 14 units are widely used.

The other main sources of expected differences between ENERGY STAR and reference home cooling loads were due to duct system efficiency and building envelope leakage.

The HERS reference home assumption is that duct systems are 80 percent efficient. This assumption may have been reasonable for Houston homes prior to building code and ENERGY STAR. The building code changes in 2002 required R-6 (or R-8) duct insulation and also required all ducts to be sealed with mastic. At the same time, ENERGY STAR homes started testing duct leakage for compliance with ENERGY STAR standards. Based on interviews with duct installers, it appears likely that all duct systems became much tighter due to the combination of the code change and the ENERGY STAR program testing. The testing provided feedback to installers and led them to develop consistent approaches to installing tight duct systems. These approaches were applied in all homes, not just ENERGY STAR homes, creating a classic case of spillover effects.

It is difficult to estimate how leaky the baseline home duct systems would have been if not for the ENERGY STAR program. But, as an example, if the ENERGY STAR program spillover improved the baseline home duct efficiency from 83 percent to 88 percent, then baseline home cooling usage would have declined by 5.7 percent due to ENERGY STAR. Without this spillover, a difference of about 10 percent would have been observed in cooling loads between ENERGY STAR and baseline homes. Furthermore, the actual overall savings from the ENERGY STAR program would have been about 15 percent of participant usage since there are about equal numbers of baseline and ENERGY STAR homes and so the 5 percent savings achieved in baseline homes should be added to the direct ENERGY STAR participant savings but instead they



are subtracted by a simple comparison of the groups. Clearly, the impacts of the ENERGY STAR program on duct system installation practices could dramatically change the conclusions about program effectiveness – potentially tripling the impacts compared to a simple billing analysis comparison.

Building envelope leakage is another area that may involve both inaccurate reference home assumptions and potential spillover impacts. Based on data in the ENERGY STAR REM/Rate files, the reference home envelope leakage rates averaged about 3,500 CFM50 prior to the 2006 changes and 3,000 CFM50 in 2006 and later. The measured leakage rates for ENERGY STAR homes averaged about 2,000 CFM50, implying a reduction in leakage of about 1,500 CFM50 prior to 2006 and 1,000 CFM50 in 2006 and later. These leakage differences imply annual cooling load savings of about 600 kWh (10 percent) prior to 2006 and 400 kWh (eight percent) since 2006, the year of the federal SEER standard change.

The HERS reference home envelope leakage rates are not climate or housing stock specific but are simply a function of the conditioned floor area of the building. The common construction practices in Houston, especially the use of slab foundations rather than basements or crawl spaces, would imply that local envelope leakage rates should be lower than in other regions. The state energy code change in 2002 also required sealing all recessed can lights, a common source of envelope leakage in new homes. The envelope leakage testing that is part of the ENERGY STAR homes program may also have affected baseline home envelope leakage rates. Framing and insulation contractors may have developed new approaches to create tighter buildings and then applied these approaches to all homes. There is less information about this possibility than about the duct systems, but some spillover is certainly possible. The study team does not have measured data on envelope leakage rates of non-ENERGY STAR homes in Houston from before or after the code changes so any conclusions would be speculative. Still, the small difference in summer/cooling loads between ENERGY STAR and baseline homes implies baseline homes are tighter than the HERS reference home estimates. The extent to which the homes are tighter due to common construction practices or spillover of skills learned from the ENERGY STAR program is unknown.

#### **Electric Usage: Baseload**

The baseload portion of usage also appeared to decline over time for all groups, although the 2007 results for baseline and guaranteed performance homes seem unusually low and high, respectively. The prior time series analysis revealed that the 2007 baseload results may be suspect due to increases in baseload usage after the first year of occupancy. Limiting the comparison to homes built through 2006, it appears that baseload electric usage declined by 9

percent for baseline homes, 5 percent for ENERGY STAR homes and 22 percent (with questionable data) for guaranteed performance homes. The baseline home baseload usage was about 3 percent higher than ENERGY STAR homes in 2002 but one percent lower in 2006.

Conclusions about baseload usage should be made with caution because, in addition to the usual sources of uncertainty, the prevalence of electric water heating (quite rare), cooking and clothes drying is unknown for these groups and small differences in fuel choice could be responsible for the observed differences across groups.

### **Electric Usage: Builder Effects**


Figure 6 on the next page shows the summer/cooling loads for each builder by year of construction with each data point label by the average air conditioner SEER of the homes.

The data points for each builder are connected with the thicker line and each point represents at least 100 homes. A 95 percent confidence interval is shown for each point as a vertical line (mostly very small). The last graph at the bottom shows the results averaged across all builders and the trend line from that analysis is also shown for reference as the thin line on each builder's graph.

The graph shows that there are significant differences in summer/cooling loads between builders and there are also substantial differences in the usage trends over time for builders. The builders with the steepest decline in usage over time – builders 3, 26, 31 and 46 – were generally the ones that increased the average air conditioner SEER the most over time, typically from 12 to 14. The builders that started with the highest SEER equipment – like builders 9 and 10 – generally had lower than average usage and a smaller change in usage over time.

The overall conclusion from the graph is air conditioner SEER appears to play a key role in summer/cooling loads. Builders that met ENERGY STAR requirements through higher SEER equipment generally performed better than those that used other methods of reaching ENERGY STAR.

Figure 6: Summer/cooling usage trends by builder and year of construction

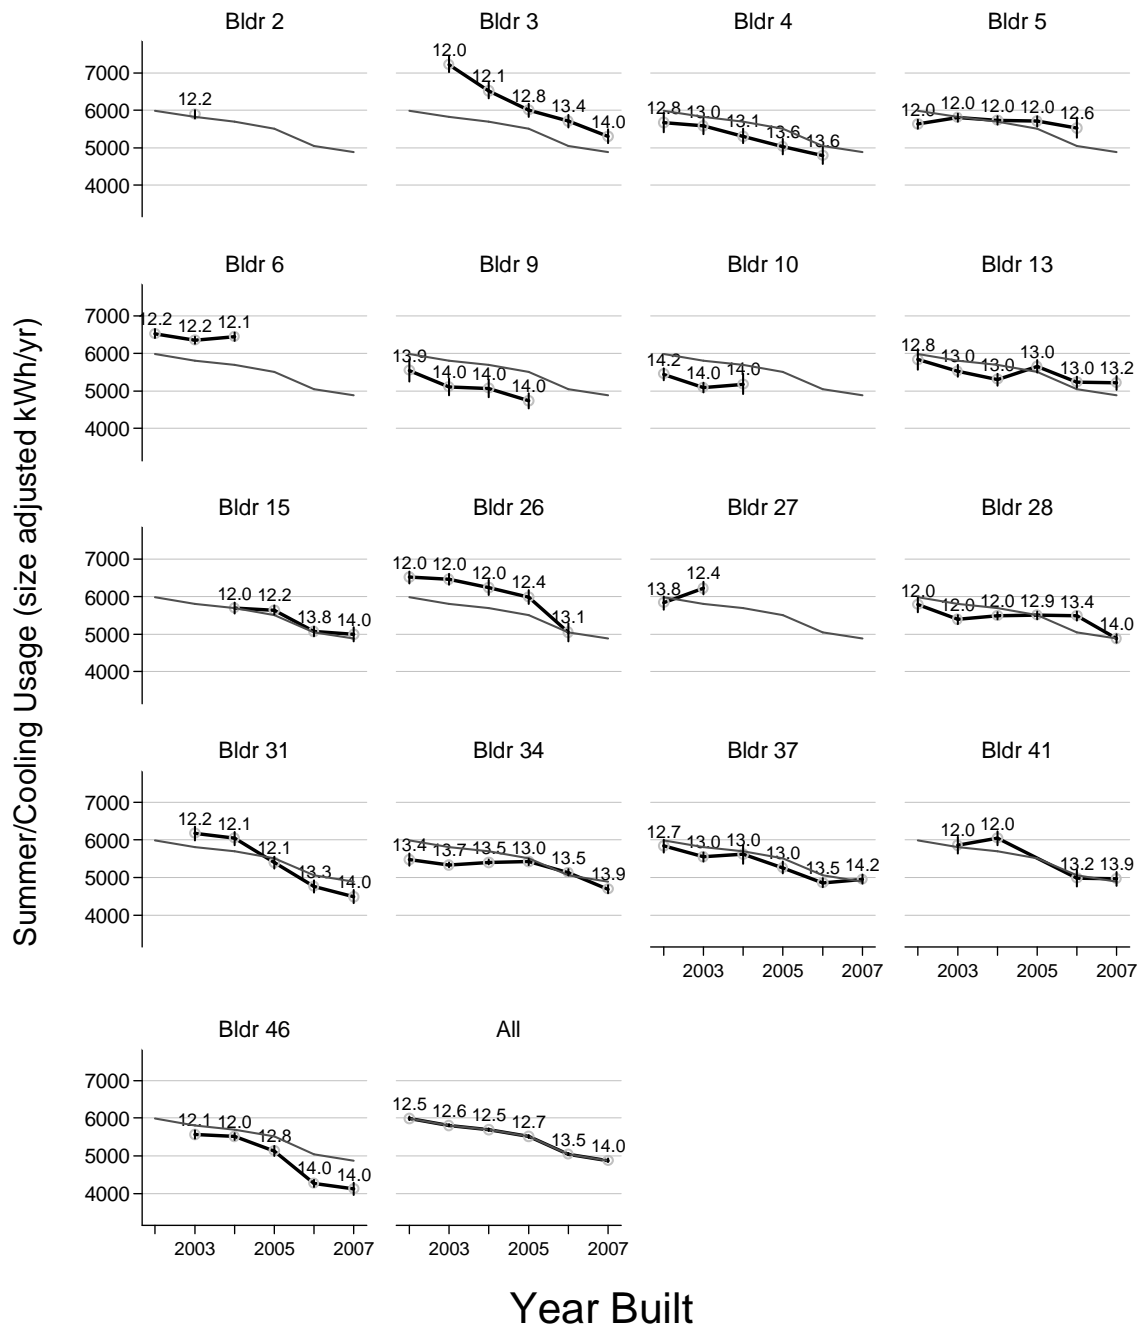

### Electric Usage: Further Analysis - Regression Modeling

Simple comparisons of energy usage between groups of homes can be informative, but more sophisticated analyses are needed to disentangle the impacts of multiple factors operating at once.

Regression modeling was used to assess the differences in energy usage over time and between groups. A regression modeling approach of homes with REM/Rate file data was also used to explore some technical performance issues. More details about the regression modeling can be found in the appendix beginning on page 56.

The regression analysis found:

- ▶ Savings from higher SEER air conditioners are generally consistent with simple projections based on the SEER ratings, although perhaps declining a little for SEER 15 units. Among homes with detailed REM data, there were more than 4,000 air conditioners rated at each of SEER 12, 13 and 14, and 203 more rated at SEER 15. Regression estimated savings from SEER 13 (vs. SEER 12) averaged about 585 kWh/yr or 9 percent of the summer/cooling load, consistent with the 8 percent expected from the SEER difference. Savings from SEER 14 (vs. SEER 12) averaged 792 kWh or 13 percent of the load, consistent with the 14 percent expected. Savings from SEER 15 (vs. SEER 12) averaged 1,001 kWh or 16 percent of load, slightly less than the 20 percent expected from simple SEER change calculations.
- ▶ About two thirds of the reduction in summer/cooling loads from 2005 to 2007 can be accounted for by changes in SEER ratings, implying that one third of the decline is due to other changes.
- ▶ Building envelope leakage appears to increase summer/cooling loads by about 0.4 kWh per CFM50 of leakage. This value is generally consistent with infiltration modeling and implies that infiltration is responsible for about 14 percent of summer/cooling loads in ENERGY STAR homes, which is 786 kWh for the average 1971 CFM50 home.
- ▶ Duct leakage as measured by a duct blaster test appears to be related to summer/cooling loads, but more weakly than envelope leakage (not unexpected). The estimated impact is about 2 kWh of summer/cooling load per CFM25 of duct leakage. This result is on the lower end of duct modeling results, which vary greatly depending on a wide range of assumptions. The 2 kWh/CFM25 impact implies that duct leakage losses only total about 172 kWh for ENERGY STAR homes (86 CFM25 average), which is about 3 percent of summer/cooling loads.
- ▶ Radiant Barrier roof sheathing appears to reduce summer/cooling loads by about 0.09 kWh/ft<sup>2</sup> of sheathing, which equals about 180 kWh/yr per home or 3 percent of summer/cooling loads.
- ▶ Baseload electric usage is strongly related to summer/cooling loads. Cooling loads increase by 0.13 kWh per annual kWh of baseload, which is consistent with the 0.12 that simple calculations would estimate assuming that 50 percent of annual baseload usage occurs during the cooling season and 80 percent of plug loads are converted to sensible loads.
- ▶ Electric baseload usage is strongly related to the size of the home (floor and envelope area about equally) and its assessed value. Baseload usage in baseline homes can be roughly estimated at about 2,800 kWh plus 1.5 kWh/ft<sup>2</sup> (floor) plus 5 kWh per \$1000 in

assessed value. In lieu of assessed value, the number of bathrooms also appears to be related to baseload usage, most likely since it is associated with higher income and/or a preference for excess.

- ▶ Guaranteed performance homes have about 4.6 percent lower summer/cooling loads than ENERGY STAR homes after accounting for building dimensions, year of construction and baseload electric usage. This difference could be due to the added quality assurance checks used in the construction of a guaranteed performance home. Guaranteed performance homes have more stringent building shell leakage and duct leakage requirements than ENERGY STAR – resulting in additional energy savings. These homes also are more likely to have more efficient products installed– vinyl instead of aluminum windows and high efficiency furnaces for example.

### **Electric Usage: Accuracy of REM/Rate Predictions**


The data collected in this project allowed the study team to examine the relationship between actual and projected energy usage. In this application, the primary quantity of interest is the projected cooling loads since baseload usage depend strongly on post-occupancy appliance acquisitions and behaviors and heating loads are small and also quite sensitive to behavioral preferences. The analysis was complicated by several factors that are all likely to reduce the correlation in the data:

- ▶ The cooling loads were not directly measured in the homes but were statistically estimated based on a weather-normalization of the monthly billing data. This estimation has inherent uncertainty and can also be expected to have some bias due to other seasonal end uses such as fans, refrigerators and lighting. True cooling loads can be expected to be a little smaller than the billing analysis estimate. Homes with pools were eliminated based on assessor data, eliminating this large source of bias.
- ▶ The REM models are run using default occupancy patterns that did not reflect any house-specific information about occupancy or inputs such as thermostat settings or schedules.
- ▶ The REM/Rate models are created for each floor plan and use threshold values for building envelope leakage and duct leakage. The actual house-specific test results are not used in the models and are generally lower than the threshold values by 10 to 20 percent. Because of this discrepancy, the REM-projected cooling loads should be biased by perhaps 3 to 5 percent high and the correlation with actual usage should be a little weaker due to not including house-specific data for these inputs.

Given these caveats, the study team examined the relationship graphically and statistically for the 10,258 homes with REM cooling load projections and electric usage results. REM projected an average cooling load of 5,506 kWh/yr while the billing analysis estimated average cooling loads at 5,677 kWh/yr, just about 3 percent higher. Given the likely positive bias in the billing data, these two figures should be considered in excellent agreement.


Figure 7 is a simple plot of projected versus actual cooling loads, where actual means from the summer/cooling load estimated by the billing data analysis. A sloping line is drawn to show perfect agreement. Although the plot shows a general correlation, there appears to be substantial scatter. But this appearance can be deceiving as many data points overlap in the middle of the plot and make outliers more noticeable.

**Figure 7: REM/Rate projected cooling loads versus actual cooling loads**

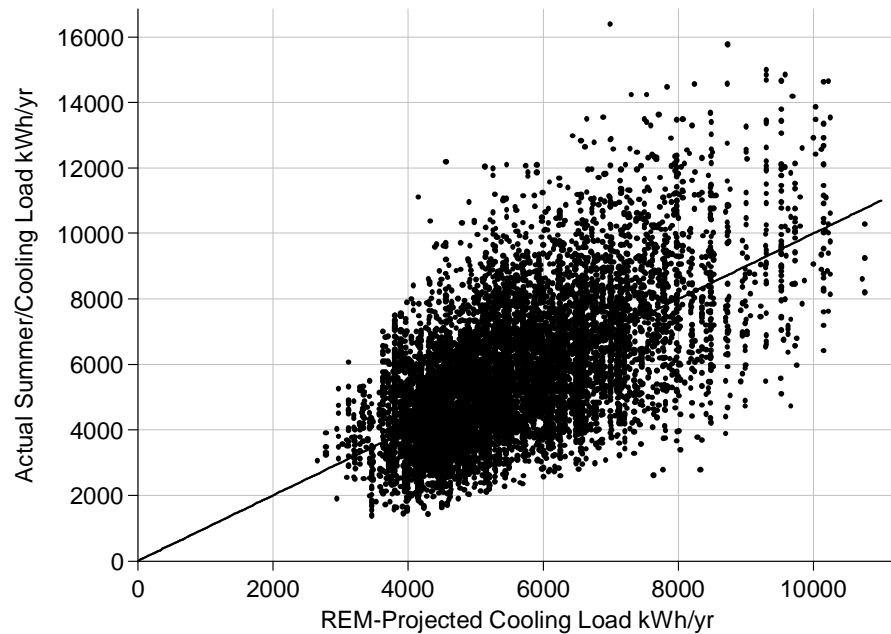

The problem inherent to graphing so many data points is addressed by summarizing the actual cooling loads for a set of 1,000 kWh wide bins of projected loads. Figure 8 shows the results of this analysis with a modified box plot for each bin. The horizontal line in the middle of each box shows the median actual cooling load, while the gray-shaded box covers the range for the middle half of the homes (the 25<sup>th</sup> to 75<sup>th</sup> percentile). The capped lines extend from the 10<sup>th</sup> to the 90<sup>th</sup> percentile of usage, indicating the central 80 percent of all homes. The diamond symbol is plotted at the mean (arithmetic average) usage for that bin. The sloping reference line is kept showing equality of the two estimates.

**Figure 8: Modified box plot of REM/Rate projected cooling loads**

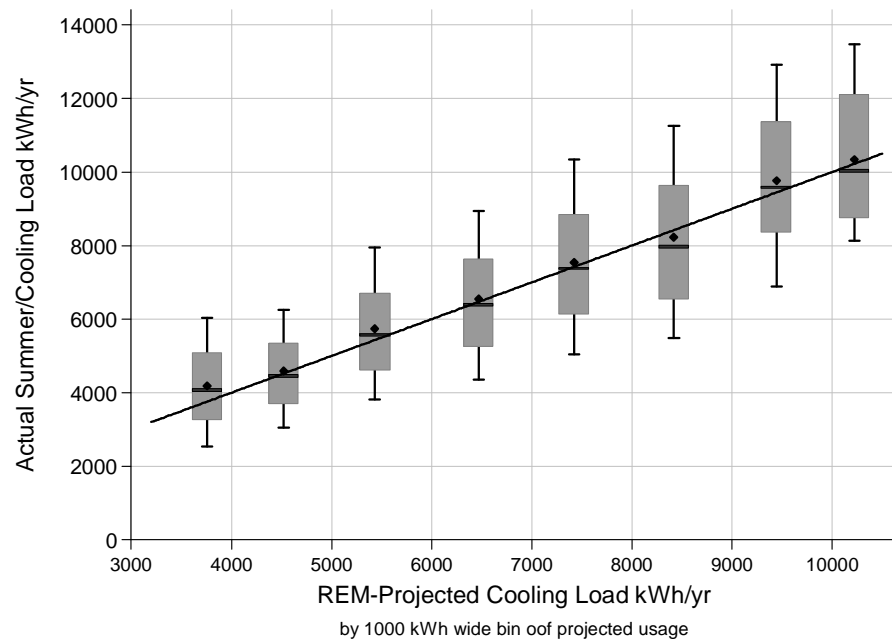

This graph appears to show a strong and fairly consistent relationship between actual and projected cooling loads. The mean values (diamonds) lie close to the reference line and the boxes generally range with 15 to 20 percent of the mean. The graph reveals no systematic bias in the REM projections. Results for any one house can certainly vary widely, but the projections appear good on average.

The key results from a statistical comparison of the REM projections and billing analysis results are summarized in the following table.

**Table 8: Statistical comparison of the REM/Rate projects and billing analysis results**

Cooling Load Projections and Usage	
Average Load (kWh/yr)	
REM	5,506
Billing data	5,677
Difference	171 (3%)
Absolute Error	
Mean	1,235 (21.8%)
Median	992 (17.5%)
% Homes where REM within	
10% of billing data	28%
15%	42%
20%	54%
25%	64%
30%	72%
40%	85%
50%	91%
Correlations with billing data	
REM	0.62
Floor area, envelope area	0.67

The average discrepancy between the REM projection and the billing analysis cooling load is about 20 percent. Nearly two thirds of all projections are within 25 percent of the billing analysis load. These results appear to indicate that the REM cooling load projections are quite good given the previous caveats about billing data bias and noise, occupancy variations and floor plan based ratings.

However, this positive assessment is deflated by the correlations listed in the final two rows of the table. Although the correlation between the REM-projected cooling load and the actual cooling load is a fairly high 0.62, the correlation is even higher between floor area or envelope area and cooling load at 0.67. In other words, the area of the home could function as a better predictor of cooling loads than the REM modeling projections if given the right formula to relate the two. The very similar energy performance characteristics of the ENERGY STAR homes in this analysis might lead one to expect almost as good a correlation for floor area as for REM projected load, but a higher correlation is surprising. Still, this finding does not change the fact that REM projections of cooling loads are reasonably accurate and unbiased on average.



### Gas Usage: Findings

The table below summarizes the characteristics of the homes in the gas usage analysis and provides some initial basic usage summaries. The table is restricted to homes built in Harris, Brazoria and Montgomery counties.

**Table 9: Gas usage analysis – sample characteristics and basic usage summaries**

	Category			Difference vs. Base	
	Base	ES	GP	ES	GP
Number of homes	10,815	15,301	659		
Floor area	2,353	2,446	2,412	93 ±19	59 ±60
Envelope area (above grade)	4,134	4,255	4,239	121 ±22	104 ±71
One-story home	61%	60%	43%	-2%	-18%
Brazoria County	6%	9%	13%	3%	8%
Harris County	91%	84%	85%	-6%	-6%
Montgomery County	4%	7%	2%	3%	-2%
Assessed value (median)	\$148,183	\$160,627	\$172,900	\$12,444	\$24,717
% Homes by Year Built					
Built 2005	19%	16%	23%	-3%	4%
Built 2006	69%	71%	66%	2%	-4%
Built 2007	11%	13%	11%	2%	0%
Gas usage: unadjusted					
Winter/heating	264	258	238	-6 ±3	-26 ±10
Baseload	174	165	162	-10 ±2	-12 ±7
Total therms/yr	438	423	400	-16 ±4	-38 ±13
Gas usage: size adjusted					
Winter/heating	274	259	243	-15 ±2	-31 ±8
Baseload	184	168	167	-16 ±2	-17 ±6
Total therms/yr	458	427	410	-30 ±3	-48 ±10
Note: ± values are 95% confidence intervals on the difference in means between the ENERGY STAR or guaranteed performance homes and the Baseline homes.					

The three groups are generally similar in size except the guaranteed performance homes are much more likely to have two stories. Similar to the electric analysis sample, baseline homes are less likely to be in Brazoria County and their median assessed value is lower than the ENERGY STAR

homes and much lower than the guaranteed performance homes. Most of the homes in the analysis were built in 2006, which is unsurprising given that the gas data only included 2006 and 2007 meter set dates and only included four months of 2008 usage.

Unlike with the electric usage data, there were no clear trends in gas consumption by house vintage. There were no major code or appliance efficiency changes expected to significantly impact gas usage in this timeframe either.

Table 9 shows that ENERGY STAR and guaranteed performance homes used less gas than baseline homes. After adjusting for the small differences in house size, heating loads averaged 15 therms (5 percent) smaller in ENERGY STAR homes than baseline homes, and 31 therms (11 percent) smaller in guaranteed performance homes than baseline homes. The narrow confidence intervals indicate these differences are statistically significant.

Given that ENERGY STAR homes generally used code-minimum insulation levels and gas equipment, heating savings would only be expected from differences in building envelope leakage, duct leakage, insulation quality (including thermal bypasses) and perhaps window U-value. REM/Rate estimated the average heating usage of the program homes fairly well – only 4 percent lower than the measured loads – but the average REM reference home was projected to use 54 percent more gas heat than the program homes. Since the baseline homes used only slightly more heat than the program homes, it appears that the baseline homes are more like the ENERGY STAR homes than they are like the assumed reference home. In other words, the baseline homes most likely have considerably tighter building envelopes and ducts than the assumptions built into the HERS reference homes, leading to lower heating usage. This finding is consistent with the cooling usage results, and details of these comparisons between reference, baseline and ENERGY STAR specs can be found in Table 4.

The gas usage analysis also found that the program homes used about 16 to 17 therms/yr less gas for baseload use than the baseline homes. However, the program homes used standard-efficiency gas water heaters and the REM modeling projected essentially no difference in water heating loads between the ENERGY STAR and reference homes (182 th/yr for ENERGY STAR vs. 184 th/yr for the reference home). Given that there are no data available to the study team on the prevalence of gas cooking and clothes drying among the baseline homes, it is hard to attribute this modest difference in baseload gas usage as a program impact.

### Gas Usage: Further Analysis

The study team analyzed the heating balance point temperatures that were statistically estimated from the billing data analysis and found that they averaged about 64.8°F for all three groups of homes. This balance point temperature is quite high compared to typical values of 60°F or lower in colder climates and implies high heating thermostat settings of perhaps 72°F or more on average.

High thermostat settings may contribute to the relatively high gas heating usage found in the billing analysis compared to the projected heating loads from simulation based studies performed by the Energy Systems Laboratory (ESL) at Texas A&M (Malhotra, 2007). An ESL analysis of options for improving on current code estimated the heating load of a typical new home in Houston at 94 therms/year compared to the 264 therms for baseline homes in the billing analysis. The simulation home floor area was almost exactly the same as the average baseline home – 2,325 ft<sup>2</sup> vs. 2,353 ft<sup>2</sup>. It seems unlikely that thermostat setting assumptions could be responsible for all of this apparent discrepancy and it may be worth pursuing a more detailed assessment, perhaps performed by ESL, of why the simulation heating usage results differ so markedly from the billing data. This difference is especially puzzling since the REM projection did not have this large bias.

In contrast to the large discrepancy in gas heating usage, the ESL simulation model projected a cooling load of 4,659 kWh, which is very close to the 4,828 kWh found from the billing analysis of the 2007 baseline homes (which averaged 2,331 ft<sup>2</sup>, just 6 ft<sup>2</sup> larger than the simulation home).


The smaller number of homes in the gas usage analysis limited the options for employing regression analysis to gain a greater understand of factors affecting usage. The regression analysis did find a strong impact of measured building envelope leakage (CFM50) on heating loads. The CFM50 value proved to be almost as strong a predictor of heating usage as the building size (floor and envelope area both performed about equally well). The estimated impact was about 0.05 therms per CFM50 of envelope leakage. This value is a little larger than might be expected based on infiltration modeling, but the modeling results are strongly influenced by assumed thermostat settings.

The regression analysis also assessed the impact of tankless gas water heaters and estimated a reduction in baseload gas usage of 38 th/yr. There were just 25 homes with tankless water heaters in the analysis sample and so the level of uncertainty is fairly large at  $\pm 26$  therms (95 percent confidence interval).

### Gas Usage: Builder Effects

Figure 9 shows the average gas heating usage by builder for builders with more than 100 homes in the analysis. The lines extend to cover a 95 percent confidence interval for each mean value. The thicker vertical line shows the overall average. There are many statistically significant differences in gas heating usage between builders; but, although these differences are statistically significant, the range of average gas usage by builder is typically within about  $\pm 50$  therms per year of the average.

Figure 9: Gas heating usage by builder

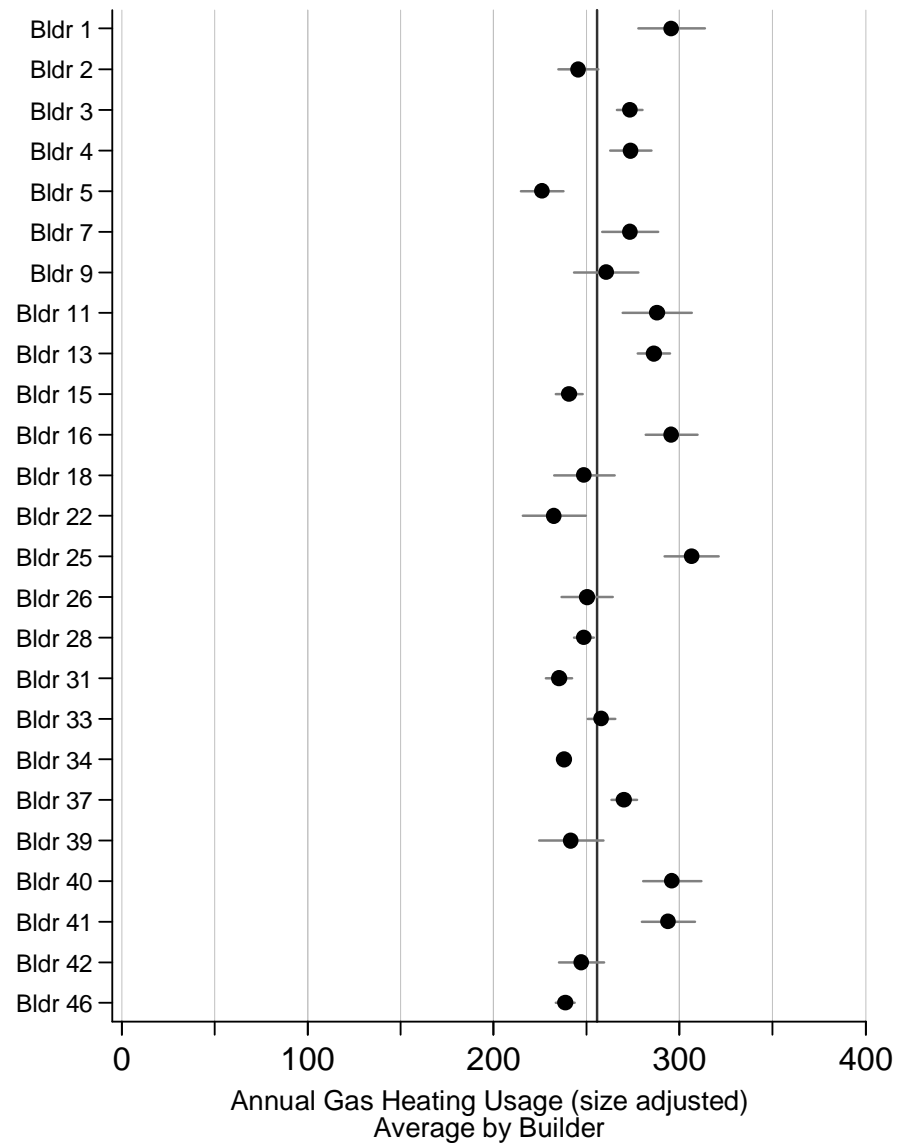

# Conclusions

The objective of the Houston Home Energy Efficiency Study is to assess the actual energy use of groups of homes built to different energy-efficiency specifications. In doing so, the study team seeks to determine if homes designed to specific energy-efficiency standards can be distinguished from each other in terms of actual energy usage. Once accomplished, further statistical techniques can be used to establish which construction features are contributing to higher energy efficiency in residential buildings.

## **All New Homes in Houston Are More Efficient Than in the Past**

The usage data indicated that new homes in Houston have become considerably more efficient in terms of cooling loads during the period 2002 through 2007. **Total electricity usage declined by 16 percent on average while cooling loads dropped by 18 percent.**

This drop in electricity consumption appears to be explained by three factors: the establishment of a statewide residential energy code in Texas in 2001, the change in federal SEER standards from SEER 10 to SEER 13 in 2006 and market transformation effects resulting from the ENERGY STAR program.

The decline in electricity usage during the early years of the study period is most likely due to the implementation of a new building code in late 2001 and increasing code compliance over time. While high SEER equipment was already prevalent in most new homes, the move to low solar gain windows and more efficient distribution systems resulted in clear drops in energy use in baseline homes.

About half of the decline in electricity use occurred from 2005 to 2007 – most likely related to the increase in the federal air conditioner efficiency standard from SEER 10 to SEER 13. While this decline is substantial, it is actually half of what the models would have predicted in moving from SEER 10 to SEER 13 (comparing 2005 to 2007 cooling use). Because of HVAC trade-offs allowed by the code in Houston, the average SEER most likely changed from about 11.5 or 12 to about 13.5 or 14, resulting in a drop in cooling usage closer to the 11 percent observed in the data.

In addition to window and SEER improvements, it appears likely that other changes in construction practices contributed toward the decline in usage. The ENERGY STAR program brought duct leakage testing and building envelope testing into widespread use in the new construction market in Houston. This testing is likely to have contributed toward the common use of better duct installation and building framing practices so that ENERGY STAR homes would pass the test

requirements. Contractors then applied these same approaches to all new homes. This phenomenon is referred to as market transformation or spillover. The impact of these widespread changes is that baseline home performance improves, narrowing any observed difference in energy usage between the ENERGY STAR homes and the baseline homes. Therefore market transformation effects can make a program appear to have less impact when in reality it is having a bigger impact.

#### **Usage Differences between ENERGY STAR and Baseline homes are small**

The data indicate that ENERGY STAR does deliver savings in Houston but the amount of savings appears to be fairly small – about 5 percent of summer/cooling loads. The installation of similar building practices and products by all builders contributed to the smaller-than-expected savings between the different groups of homes.

It is important to clarify that these results do not mean ENERGY STAR homes are using more energy than predicted. **ENERGY STAR homes perform very close to the predictions of the HERS models, but baseline homes perform much better than the reference homes defined by the HERS standard.** The better-than-code construction practices of baseline homes substantially reduced the difference between ENERGY STAR and baseline homes.

For example, when modeling an ENERGY STAR home in Houston, the increased efficiency of air conditioning equipment represents a large portion of the savings relative to the reference home. However, data collected from the National Association of Home Builders (Habrel, 2005) and discussions with HVAC distributors and installers in Houston (Installers, 2008) indicated that most builders in Houston installed high efficiency cooling equipment well before the establishment of the ENERGY STAR program. When 10 SEER was the minimum A/C efficiency standard, the typical home in Houston apparently used 12 SEER equipment. As a result, about half of the total anticipated cooling savings in an ENERGY STAR home relative to a baseline home was never realized.

Reference home assumptions do not only apply to products and equipment efficiencies but also appear to overestimate building envelope leakage and perhaps distribution system leakage. These two construction characteristics can have a significant impact on energy performance. After A/C equipment efficiency, the projected savings from improved distribution systems and tighter building envelopes make up the majority of the expected savings in a Houston ENERGY STAR home. However, the ducts and building envelope in typical baseline homes are most likely tighter and more efficient than the reference home assumption, further narrowing the difference in observed loads.

### **REM/Rate Accurately Predicts Heating and Cooling Loads, on Average**

The relationship between REM/Rate cooling load projections and actual electric usage was examined graphically and statistically for 10,258 homes with sufficient data. REM/Rate projected an average cooling load of 5,506 kWh/yr while the billing analysis estimated average cooling loads at 5,677 kWh/yr, about 3 percent higher – excellent overall agreement. Although the analysis found no systematic bias in the REM/rate cooling projections, there was a large amount of variability in the data. Findings revealed that the correlation was higher between house size and cooling load than between REM/Rate projected cooling load and actual usage. **However, the study team feels confident in stating that when using current modeling software with energy-efficient new homes, there is a strong and fairly consistent relationship between actual and projected performance using REM/Rate for both heating and cooling.**

## Recommendations

**Billing analysis provides the most accurate measurement of program results and clarifies what specifications provide energy savings in new construction programs such as ENERGY STAR.** While modeling and projected savings provide an excellent starting point, there is always a need for on-going evaluation and feedback loops involving real-world data. Doing so will help clarify our models and develop more accurate assumptions. Likewise, there is a need for actual building data to benchmark current construction practices in order to determine the level of standards for any program. On a national basis, ENERGY STAR programs are implemented in many different markets with differences in local codes, starts, utility involvement, contractor base and any number of factors. All of these differences make benchmarking on an ongoing basis important.

The extent of improvements in standard construction practices and energy savings in residential buildings as a result of spillover effects from the ENERGY STAR program in Houston is unknown. However, market transformation from ENERGY STAR appears to have taken place and resulted in very positive benefits to consumers and electricity savings. Therefore, the narrowing gap between ENERGY STAR and baseline homes may be a sign of bigger program impacts rather than smaller program impacts. Thus, it makes sense for utility planners and policy makers to determine how programs can get credit for the savings achieved by non-program homes.

**This narrowing of energy savings between baseline and ENERGY STAR homes justifies an increase in the ENERGY STAR standard.** In the Houston market the ENERGY STAR specification is no longer stringent enough. Version three of ENERGY STAR, slated for 2011, intends to answer this need. And a market like Houston, because of the investment in the current ENERGY STAR program, provides an infrastructure to meet the new specification. More clear and stringent standards need to be developed while providing the necessary support to raters so they can push the new construction market and truly differentiate committed builders.

**Finally, while ENERGY STAR needs to increase its standards** in order to push the market forward for high-performance buildings, **states and municipalities with little to no presence of ENERGY STAR or HERS raters should develop local strategies for addressing their energy-efficiency needs.** The ENERGY STAR program appears to have helped facilitate code compliance in many markets. By participating in ENERGY STAR, builders have often received a modest financial incentive from the local utility, and have also been able to work with a HERS rater to help navigate new energy codes. However, moving to the 2011 ENERGY STAR standard from



current practice will be a considerable leap forward for builders in markets with less stringent residential energy codes and few HERS raters.

One option is to follow the approach Texas took when adopting their residential energy code in 2001. Texas developed the Texas Energy Partnership to help the counties and cities affected by the new code. The partnership was led by the State Energy Conservation Office and included the resources of the U.S. Department of Energy and the Texas ENERGY STAR program (State Energy Conservation Office). The partnership provides information on setting goals, determining strategies and allocating resources for achieving energy code compliance. It provides local expertise, leadership support and access to national laboratories and technical resources. This could serve as a great lesson for utilities in states that historically have minimal energy codes and a lack of education around better building practices. Tremendous opportunities for capturing energy savings and improving the quality of buildings exist in these markets. Throughout the country, the ENERGY STAR program has provided a foundation for training a workforce of on-the-ground building performance professionals. These people, in turn, are able to provide education to builders and trades and speed up the transformation of new construction markets.

## Works Cited

- Advanced Energy. (2009). Advanced Energy internal database of program data. (*not published*) .
- Advanced Energy Corporation. (n.d.). *Advanced Energy, an Energy Efficiency Services Firm*. Retrieved October 19, 2009, from Advanced Energy: <http://www.advancedenergy.org/>
- Advanced Energy. (2005). *Phoenix Home Energy Efficiency Study*. Retrieved from [http://www.advancedenergy.org/buildings/services/docs/FINAL%20PAPER%20EPA%20Phx%20Study\\_v2.pdf](http://www.advancedenergy.org/buildings/services/docs/FINAL%20PAPER%20EPA%20Phx%20Study_v2.pdf)
- Advanced Energy. (2009). *SystemVision*. Retrieved from <http://www.systemvision.org>
- Ahmad, M., Im, P., Mukhopadhyay, J., Malhotra, M., Haberl, J., Culp, C., et al. *Impact of the Implementation of the 2000/2001 IECC on Residential Energy Use in Texas: Analysis of Residential Energy Savings*. College Station: Energy Systems Laboratory Texas A&M University.
- Architectural Energy Corporation. (n.d.). *AEC - REM Home Energy Analysis Software*. Retrieved 2009, from <http://www.archenergy.com/products/rem/>
- Baltazar-Cervantes, J. P., Culp, C., Haberl, J. S., & Yazdini, B. (2006). *Impact of the Implementation of the 2000/2001 IECC on Residential Energy Use in Texas: Preliminary Verification of Residential Energy Savings*. College Station: Energy Systems Laboratory, Texas Engineering Experiment Station, Texas A&M University.
- Bashford, B. (May 2000). *Energy consumption comparison of ENERGY STAR homes in Phoenix, Arizona*. Arizona State University.
- Distributors, H. (2008). (S. Hassel, Interviewer)
- Fels, M. (1986). PRISM: An Introduction. *Energy and Buildings* , Vol. 9, N. 1-2, pp. 5-18.
- General Electric. (2009). *GE ecomagination: Homes Inspired by ecomagination*. Retrieved from <http://ge.ecomagination.com/products/eco-homebuilder.html>
- Habrel, J. C. (2005). *Impact of the Implementation of the 2000/2001 IECC on Residential Energy Use in Texas: Analysis of Residential Energy Savings*. Energy Systems Laboratory, Texas A7m university.
- Hall, K. S. (2005). *Report on North Carolina REM/Rate Study*.
- Harris, J., & Blasnik, M. (2007). *Reference Design Guide for Highly Energy Efficient Residential Construction*. Burlington: Vermont Energy Investment Corporation; Conservation Services Group.
- Installers. (2008). Personal phone call. (S. Hassel, Interviewer)
- Keefe, D. (1994). *Introduction to Blower Doors*. Retrieved October 19, 2009, from Home Energy Magazine Online: <http://www.homeenergy.org/archive/hem.dis.anl.gov/eehem/94/940110.html>
- (2005). *Low Solar Heat Gain Windows: Successful Market Transformation in Georgia and Texas*. U.S. Department of Energy, Office of Energy Efficiency and Renewable Energy.

- (2005). *Low Solar Heat Gain Windows: Successful Market Transformation in Georgia and Texas*. U.S. Department of Energy Office of Energy Efficiency and Renewable Energy.
- Malhotra, M. e. (2007). *Recommendations for 15% above-code energy efficiency measures for single family residences*. Retrieved from Energy Systems Laboratory: <http://txspace.tamu.edu/bitstream/handle/1969.1/6300/ESL-HH-07-12-05a.pdf?sequence=8>
- Masco Corporation. (2008, October 23). *Environments for Living*. Retrieved from <http://www.environmentsforliving.com>
- Pigg, S. (2002). *Energy Savings from the Wisconsin ENERGY STAR Homes Program*. Madison: Energy Center of Wisconsin.
- Proctor, J., Blasnik, M., Davis, B., Downey, T., Modera, M., Nelson, G., et al. (1993, September/October). *Diagnosing Ducts: Finding the Energy Culprits*. Retrieved October 19, 2009, from Home Energy Magazine Online: <http://www.homeenergy.org/archive/hem.dis.anl.gov/eehem/93/930911.html>
- (2005). *Report on North Carolina REM/Rate Comparison Study*. Boone: Appalachian State University Energy Center.
- RESNET. (n.d.). *RESNET - Energy Ratings and Mortgages*. Retrieved 2009, from Residential Energy Services NETwork (RESNET): <http://www.resnet.us/ratings/overview/default.htm>
- State Energy Conservation Office. (n.d.). *State Energy Conservation Office*. Retrieved 10 28, 2009, from ENERGY STAR: <http://www.seco.cpa.state.tx.us/energystar.htm>
- (2002). *Texas Building Code and Energy Performance Standards*. U.S. Department of Energy.
- Tucson Electric Power. (2008). *Tucson Electric Power Company - We're there when you need us* . Retrieved from <http://www.tucsonelectric.com/Green/GuaranteeHome/index.asp>
- U.S. Department of Energy. (2004). *Buildings Energy Databook*.
- U.S. DOE. (2009, February 10). *DOE: Building Energy Codes - REScheck Residential Code Compliance*. Retrieved from U.S. DOE EERE: <http://www.energycodes.gov/rescheck/>
- U.S. EPA. (2009, March). *ENERGY STAR Qualified New Homes brochure*. Retrieved from [http://www.energystar.gov/ia/partners/downloads/consumer\\_brochure.pdf](http://www.energystar.gov/ia/partners/downloads/consumer_brochure.pdf)
- Yazdani, B. (2005, December 28). *Compliance Options for Insulating Ducts in Unconditioned Attics for Projects Permitted On or After Jan. 23, 2006*. College Station: Energy Systems Laboratory Texas Engineering Experiment Station Texas A&M University.
- Yazdini, B., Culp, C., Montgomery, C., Gilman, D., Haberl, J., Malhotra, M., et al. (2006). *An Analysis of the Residential Energy Savings From the Implementation of the 2001 IECC and 2006 NAECA Appliance Standards in the State of Texas*. College Station: Energy Systems Laboratory, Texas A&M University.

## Website Resources

- ▶ [www.advancedenergy.org](http://www.advancedenergy.org)
- ▶ [www.centerpointenergy.com](http://www.centerpointenergy.com)
- ▶ [www.energystar.gov](http://www.energystar.gov)

# Appendix

## Regression Analysis

The table below shows the regression modeling output for the electric summer/cooling usage. The results for eight different regression models are shown side by side. Each coefficient's standard error is shown in parentheses.

**Table 10: Regression modeling output for the electric summer/cooling usage**

	Base		Base2		Robust		Areas		Duct		Shell		Duct & Shell		Duct/Shell Robust	
Air Conditioner SEER																
SEER 13	-566	(34)	-569	(32)	-585	(32)	-566	(33)	-381	(73)	-387	(66)	-357	(64)	-384	(63)
SEER 14	-831	(32)	-823	(30)	-792	(29)	-790	(30)	-714	(84)	-688	(75)	-638	(61)	-641	(61)
SEER 15	-1154	(111)	-1105	(105)	-1001	(102)	-1074	(105)	-853	(139)	-895	(145)	-713	(134)	-697	(133)
Building Component Areas																
Ceiling	0.71	(.04)	0.54	(.04)	0.49	(.04)	-6.91	(1.07)	0.23	(.09)	0.23	(.09)	0.61	(.07)	0.57	(.07)
RadBar Roof	-0.08	(.02)	-0.08	(.02)	-0.09	(.02)	-0.08	(.02)	-0.16	(.03)	-0.13	(.03)	-0.16	(.04)	-0.16	(.04)
Cath Ceiling	0.72	(.08)	0.61	(.07)	0.62	(.07)	-6.80	(1.08)	0.49	(.14)	0.52	(.15)	0.81	(.15)	0.85	(.15)
Walls	0.79	(.04)	0.67	(.04)	0.61	(.04)	-6.72	(1.08)	0.47	(.08)	0.47	(.08)	0.56	(.09)	0.54	(.09)
Windows	3.1	(0.2)	2.6	(0.2)	2.6	(0.1)	-5.5	(01.1)	0.6	(0.3)	0.5	(0.3)	1.0	(0.3)	1.0	(0.3)
Skylights	9.3	(5.8)	11.2	(5.4)	9.9	(5.3)	7.2	(5.5)	-6.8	(13.7)	-41.0	(19.)	-39.0	(19.1)	-41.3	(19.)
Other Building Size Indicators																
# Stories	612	(52)	505	(49)	485	(47)	295	(52)	194	(102)	174	(104)	518	(103)	515	(102)
Floor Area							0.63	(.05)	0.76	(.10)	0.70	(.10)				
Shell Area							7.2	(1.1)								
Measured Leakage																
Duct CFM25									2.7	(.71)			2.0	(.76)	2.0	(.75)
Shell CFM50											0.25	(.06)	0.39	(.07)	0.38	(.07)
Other Factors																
Window SHGC	1083	(298)	1227	(281)	1249	(273)	1622	(281)	-822	(935)	109	(921)	-2424	(1219)	-2243	(1207)
Baseload Electric kWh/yr			0.123	(.003)	0.131	(.003)	0.119	(.003)	0.108	(.005)	0.106	(.005)	0.111	(.006)	0.114	(.006)
Guaranteed Performance	-355	(41)	-308	(39)	-288	(38)	-270	(39)	19	(64)	98	(56)				
Year Effects																
Y2003	-259	(45)	-222	(42)	-243	(41)	-216	(42)	0	()	-149	(136)				
Y2004	-335	(46)	-268	(43)	-270	(42)	-256	(43)	-247	(218)	-192	(140)				
Y2005	-362	(49)	-277	(47)	-253	(45)	-278	(47)	-127	(211)	-131	(137)				
Y2006	-440	(51)	-348	(48)	-352	(47)	-368	(48)	-212	(215)	-240	(139)				
Y2007	-564	(57)	-431	(54)	-429	(53)	-470	(54)	-96	(218)	-160	(141)				
Constant	995	(138)	719	(130)	821	(126)	379	(138)	1226	(429)	915	(350)	1219	(460)	1220	(456)
# Obs	16408		16408		16408		16408		3985		4386		3255		3255	
Adj R-squared	0.443		0.505		0.51		0.51		0.487		0.487		0.489		0.487	

The "Base" model includes a base set of predictors that include variables for:

- Air conditioner SEER, where SEER 12 is the baseline and there are separate estimates for the incremental impacts of SEER 13, 14 and 15
- Building component areas for ceilings, cathedral ceilings, above grade walls, windows and skylights as well as a separate variable for the area of radiant barrier roof sheathing
- Other building size indicators including number of stories (in the base model)

- ▶ Window solar heat gain coefficient
- ▶ An indicator for guaranteed performance participation
- ▶ Construction year-specific effects

All of these variables are highly statistically significant with the exception of skylight area which is just marginally statistically significant. The model was estimated based on 16,408 observations and the adjusted R-squared was 0.44.

The “Base2” model adds the electric baseload usage as a predictor which is highly statistically significant and is included in all of the other models.

The “Robust” model is the same as the Base2 model except that the regression is estimated using a robust regression method that down-weights outliers (Stata’s `rreg` command). The differences are generally slight, indicating that outliers are not having a substantial impact on the results.

The “Areas” model adds in the conditioned floor area and above grade wall area into the model. These variables are highly collinear with the component area predictors and so render all of the area-based coefficients uninterpretable. But this area-saturated model does provide additional explanatory power and may shed light on the estimated impacts of the other model coefficients.

The “Duct” model adds the measured duct leakage CFM25 to the prior model and drops the shell area. This model is based on far fewer observations – the 3985 homes with measured duct leakage and REM files. The “Shell” model adds the measured shell leakage and drops the duct leakage so that it can include all 4,386 homes with measured shell leakage data. The “Duct & Shell” model includes the 3,255 homes with both measured shell and duct leakage data and drops all of the year effects variables because they were not statistically significant for the duct or shell subsets. The estimated impact of shell leakage increases while duct leakage impact decreases compared to the separate models. The “Duct/Shell Robust” model is the same as the prior model but was estimated using robust regression.